

# RB163-06/07

## R301.2.1.1, Chapter 6

**Proponent:** Robert Boyer, Palm Beach County, Longwood, FL, representing The Building Officials Association of Florida

### 1. Revise as follows:

**R301.2.1.1 Design criteria.** Construction in regions where the basic wind speeds from Figure R301.2(4) equal or exceed 100 miles per hour (45 m/s) in hurricane-prone regions, ~~or 110 miles per hour (49m/s) elsewhere,~~ shall be designed in accordance with one of the following:

1. American Forest and Paper Association (AF&PA) Wood Frame Construction Manual for One- and Two-Family Dwellings (WFCM); or
2. Southern Building Code Congress International Standard for Hurricane Resistant Residential Construction (SSTD 10); or
3. Minimum Design Loads for Buildings and Other Structures (ASCE-7); or
4. American Iron and Steel Institute (AISI), Standard for Cold-Formed Steel Framing—Prescriptive Method For One- and Two-Family Dwellings (COFS/PM) with Supplement to Standard for Cold-Formed Steel Framing—Prescriptive Method For One- and Two-Family Dwellings.
5. Concrete and concrete masonry construction shall be designed in accordance with the provisions of this code or in accordance with the applicable documents adopted in Section R301.2.1.1; or,
6. International Building Code.

**R601.2 Requirements.** Wall construction shall be capable of accommodating all loads imposed according to Section R301 and of transmitting the resulting loads to the supporting structural elements. A continuous load path between foundations walls, and roofs shall be provided.

### 2. Add new text as follows:

**R601.2.2 Fastening devices.** Approved connectors, anchors and other fastening devices not included in this code shall be installed in accordance with the manufacturer's recommendations.

**R601.2.3 Corrosive conditions.** Metal plates, connectors, screws, bolts and nails exposed directly to the weather or subject to salt corrosion in coastal areas, as determined by the building official, shall be stainless steel, hot dipped galvanized after the fastener or connector is fabricated to form a zinc coating not less than 1 oz per sq ft, or hot dipped galvanized coated with a minimum of 1.8 oz per sq ft of steel.

### 3. Revise as follows:

**R606.2 Thickness of masonry.** The nominal thickness of masonry walls shall conform to the requirements of Sections R606.2.1 through R606.2.4.

**R606.2.1 Minimum thickness.** The minimum thickness of masonry bearing walls more than one story high shall be 8 inches (203 mm). Solid masonry walls of one-story dwellings and garages shall not be less than 6 inches (152 mm) in thickness when not greater than 9 feet (2743 mm) in height, provided that when gable construction is used, an additional 6 feet (1829mm) is permitted to the peak of the gable. Masonry walls shall be laterally supported in either the horizontal or vertical direction at intervals as required by Section R606.9. Where the basic wind speeds from Figure 301.2.4 equal or exceed 100 mph, the minimum nominal thickness of masonry bearing walls shall be not less than 8 inches (203 mm).

**R606.5 Allowable stresses.** Allowable compressive stresses in masonry shall not exceed the values prescribed in Table R606.5. Where the basic wind speeds from Figure 301.2.4 equal or exceed 100 mph, concrete masonry units shall be hollow or solid unit masonry in accordance with ASTM C 90 and shall have a minimum net area compressive strength of 1900 psi when using Type M or S mortar. In determining the stresses in masonry, the effects of all loads and conditions of loading and the influence of all forces affecting the design and strength of the several parts shall be taken into account.

**R606.9.2.1 Roof structures.** Masonry walls shall be anchored to roof structures with metal strap anchors spaced in accordance with the manufacturer's instructions, 1/2-inch (13 mm) bolts spaced not more than 6 feet (1829 mm) on center, or other approved anchors. Anchors shall be embedded at least 16 inches (406 mm) into the masonry, or be hooked or welded to bond beam reinforcement placed not less than 6 inches (152 mm) from the top of the wall. Anchorage shall be rated to transfer the horizontal wind load to the roof diaphragm.

**R606.9.2.2 Floor diaphragms.** Masonry walls shall be anchored to floor diaphragm framing by metal strap anchors spaced in accordance with the manufacturer's instructions, 1/2-inch-diameter (12.7 mm) bolts spaced at intervals not to exceed 6 feet (1829 mm) and installed as shown in Figure R606.11(1), or by other approved methods. Anchorage shall be rated to transfer the horizontal wind load to the floor diaphragm.

**4. Add new text and figures as follows:**

**R606.16 Wind design requirements.** Where the basic wind speeds from Figure 301.2.4 equal or exceed 100 mph, reinforcement for concrete masonry construction shall comply with Sections R606.16.1 through R606.16.8

**R606.16.1 Reinforcement.** Reinforcing steel shall be a minimum of Grade 60 or Grade 40 No. 5 or No. 4 bars and shall be identified in an approved manner.

**R606.16.2 Bundling.** Where two bars are required at the same location in a wall or in a bond beam, bundling shall be permitted.

**R606.16.3 Splicing.** Splices shall be lap splices. Non-contact lap splices shall be permitted provided reinforcing bars are not spaced farther apart than 5 inches. Splice lengths shall be in accordance with Table R606.16.3 and shall be a minimum of 25 inches for No. 5 bars and 20 inches for No. 4 bars.

**TABLE R606.16.3  
LAP SPLICE LENGTHS**

<b>Bar Size (No.)</b>	<b>Lap Length (in.)</b>
<u>3</u>	<u>15.1</u>
<u>4</u>	<u>20.1</u>
<u>5</u>	<u>25.2</u>
<u>6</u>	<u>42.8</u>
<u>7</u>	<u>59.4</u>

**R606.16.4 Bending.** Reinforcement shall be bent in the shop or in the field. All reinforcement shall be bent cold. The diameter of the bend, measured on the inside of the bar, shall not be less than six-bar diameters. Reinforcement partially embedded in concrete shall not be field bent.

**Exception:** Where bending is necessary to align dowel bars with a vertical cell, bars partially embedded in concrete shall be permitted to be bent at a slope of not more than 1 inch of horizontal displacement to 6 inches of vertical bar length.

**R606.16.5 Clearance from masonry.** Reinforcing bars embedded in grouted masonry cells shall have a minimum clear distance between reinforcing bars and any face of a cell of ¼-inch for fine grout or ½-inch for coarse grout.


**R606.16.6 Cleanout openings.** Cleanout openings shall be provided for cells containing spliced reinforcement when the grout pour exceeds 5 feet in height. Where cleanout openings are required, an opening shall be provided in the bottom course of the masonry cell to be filled. Cleanout openings shall have a minimum opening dimension of 3 inches.

**R606.16.7 Termination.** All vertical wall reinforcement shall be terminated by hooking into a bond beam or footing with a standard hook. Standard hooks shall be formed by bending the vertical wall reinforcement in accordance with Section R606.16.4 or shall be a prefabricated standard hook. Splices to standard hooks shall be lap splices with the minimum extension length beyond the bend for standard hooks of 10 inches for No. 5 bars and 8 inches for No. 4 bars. Hooks at bond beams shall extend to the uppermost horizontal reinforcement of the bond beam and shall be embedded a minimum of 6 inches into the bond beam as detailed in Figure R606.16.7A and Figure R606.16.7B. Where multiple bars are required, a single standard hook shall terminate into the bond beam or footing. In narrow footings where the width is insufficient to accommodate a standard 90-degree hook and provide the required concrete cover, the hook shall be rotated in the horizontal direction until the required concrete cover is achieved.


**R606.16.8 Continuity multi-story construction.** Vertical wall reinforcement in multi-story construction shall extend through bond beams and shall be continuous with the vertical wall reinforcement of the wall above or be offset in accordance with Section R606.16.8.1 and Figure R606.16.7B

**Exception:** Where more than one bar in the same cell is required for vertical wall reinforcement, only one bar shall be required to be continuous between stories.

**R606.16.8.1 Offset reinforcement.** Vertical reinforcement shall be permitted to be offset between floor levels. Reinforcement for the lower story shall be anchored into the upper floor level bond beam and reinforcement for the upper story shall be anchored into the bond beams above and below in accordance with Section R606.16.7 and Figures R606.16.7A and R606.16.7B.

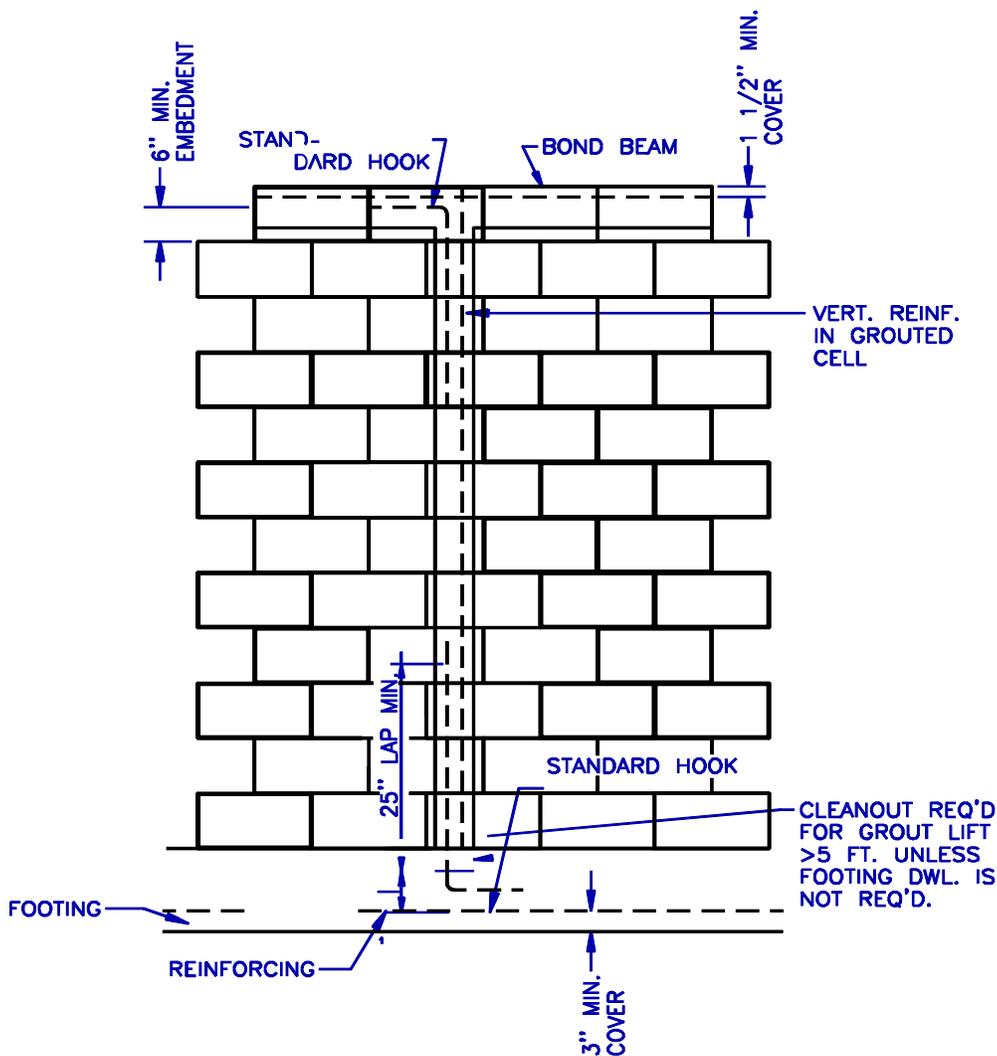

**FIGURE R606.16.7A**  
**CONTINUITY OF REINFORCEMENT**  
**ONE STORY MASONRY WALL**

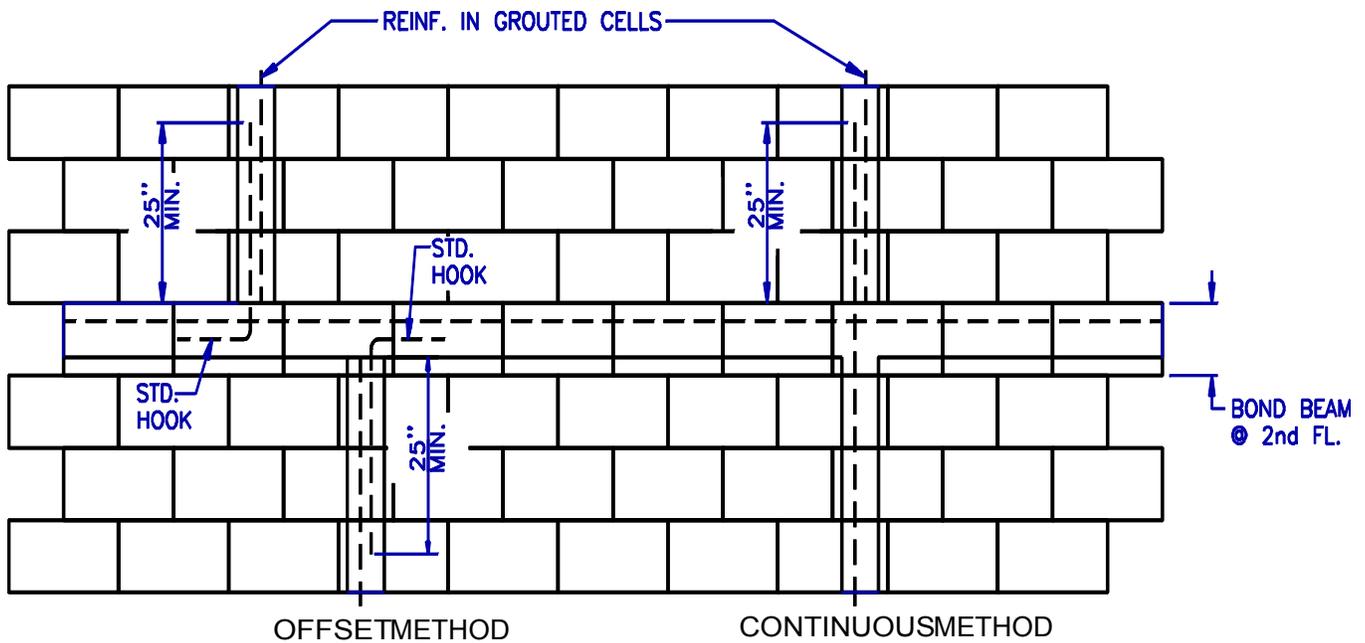

**FIGURE R606.16.7B**  
**CONTINUITY OF FIRST AND SECOND FLOOR**  
**VERTICAL WALL REINFORCEMENT (#5 BAR)**

5. Revise figure title as follows:

**FIGURE R606.11(1)**  
**ANCHORAGE REQUIREMENTS FOR MASONRY WALLS LOCATED**  
**IN SEISMIC DESIGN CATEGORY A, B OR C AND**  
**WHERE BASIC WIND LOADS SPEEDS ARE LESS THAN 30 PSF 100 MPH**

(No change to figure)

**R607.1.4 All other masonry.** Mortar for masonry serving as the lateral-wind-force-resisting system shall be Type M, S or N mortar. Mortar for masonry serving as the lateral-wind-force-resisting system where the basic wind speeds from Figure 301.2.4 equal or exceed 100 mph shall be either Type M or S.

6. Revise as follows:

**R609.1 General.** Grouted multiple-wythe masonry is a form of construction in which the space between the wythes is solidly filled with grout. It is not necessary for the cores of masonry units to be filled with grout. Grouted hollow unit masonry is a form of construction in which certain cells of hollow units are continuously filled with grout. Grouted hollow unit masonry constructed where the basic wind speeds from Figure 301.2.4 equal or exceed 100 mph shall comply with Sections R609.1 and R609.5 through R609.9

**R609.1.2 Grout lift height.** ~~Grouting requirements. Maximum pour heights and the minimum dimensions of spaces provided for grout placement shall conform to Table R609.1.2.~~ Where the following conditions are met, placement of grout in lifts not exceeding 12.67 ft (3.86 m) shall be permitted.

1. The masonry has cured for at least 4 hours.
2. The grout slump is maintained between 10 and 11 in. (254 and 279 mm).
3. No intermediate reinforced bond beams are placed between the top and the bottom of the pour height.

Otherwise, place grout in lifts not exceeding 5 ft (1524 mm). ~~If the work grouting is stopped for one hour or longer, the horizontal construction joints shall be formed by stopping all tiers at the same elevation and with the grout 1 inch (25 mm) below the top.~~

7. Delete table without substitution:

**TABLE R609.1.2**  
**GROUT SPACE DIMENSIONS AND POUR HEIGHTS**

8. Revise as follows:

**R609.1.4 Grout placement.** All cells containing reinforcement or anchor bolts shall be grouted solid. Grout shall be a plastic mix suitable for pumping without segregation of the constituents and shall be mixed thoroughly. Grout shall have a maximum coarse aggregate size of 3/8-inch and shall be placed at an 8 to 11-inch slump and have a minimum specified compressive strength of 2000 psi at 28 days when tested in an approved manner or shall be in accordance with ASTM C 476. Grout shall be placed by pumping or by an approved alternate method and shall be placed before any initial set occurs and in no case more than 1 1/2 hours after water has been added. Grouting shall be done in a continuous pour, in lifts not exceeding ~~5 feet (1524 mm).~~ the heights specified in Section 609.1.2 and it shall be consolidated by puddling or mechanical vibrating during placing and reconsolidated after excess moisture has been absorbed but before plasticity is lost.

**R609.1.5 Cleanouts.** ~~Where required by the building official, cleanouts shall be provided as specified in this section.~~ Cleanouts shall be provided at the bottom course at each pour of grout where such pour exceeds 5 feet (1524 mm) in height and where required by the building official. Cleanouts shall be provided with an opening of sufficient size to permit removal of debris. The minimum opening dimension shall be 3 in. (76 mm). The cleanouts shall be sealed before grouting and after inspection.

**R609.1.5.2 Grouted hollow unit masonry.** Cleanouts shall be provided at the bottom course of each cell to be grouted at each pour of grout, where such pour exceeds ~~4~~ 5 feet (1524 mm) in height.

9. Add new text as follows:

**R609.5 Bond beams.** Exterior walls of grouted hollow unit masonry constructed where the basic wind speeds from Figure 301.2.4 equal or exceed 100 mph shall be provided with a reinforced bond beam at the top of the wall and at each floor level.. Masonry walls not extending to the roof line shall have a bond beam at the top of the wall.

**Exceptions:**

1. A bond beam is not required at the floor level for slab-on-ground floors.
2. Gable endwalls shall be in conformance with Section R609.7.

**R609.5.1 Bond beam types.** Bond beams shall be one of the following:


1. 8" thick x 8" high masonry  
8" thick x 12" high masonry.  
8" thick x 16" high masonry.  
8" thick x 32" high masonry.
2. Precast units certified by the manufacturer for the uplift loads as set forth in Table R802.11. Precast units shall be installed in accordance with the manufacturer's specifications, and approved by the building official.

**R609.5.2 Bond beam reinforcement.** The minimum bond beam roof diaphragm chord tension reinforcement steel shall be as set forth in Table R609.5.2A-1 through Table R609.5.2A-4 for the appropriate Exposure Category. The minimum reinforcement for bond beam uplift resisting reinforcement steel shall be as set forth in Tables R609.5.2B-1 thru R609.5.2B-8 for the loads set forth in Table 802.11. The total minimum area of bond beam reinforcement shall be the sum of the required area of the diaphragm chord tension steel and the required area of bond beam uplift steel. Bond beam steel area shall be converted to bar size in accordance with Table 609.5.2C.

**R609.5.3 Location of reinforcement.** Reinforcement shall be located in the top of bond beams and in the top and bottom of bond beams also serving as lintels.

**R609.5.4 Corner continuity.** Corner continuity. Reinforcement in bond beams shall be continuous around corners as detailed in Figure R609.5.4.


**Exception:** In bond beams requiring two reinforcing bars, one bar shall be continuous around corners.

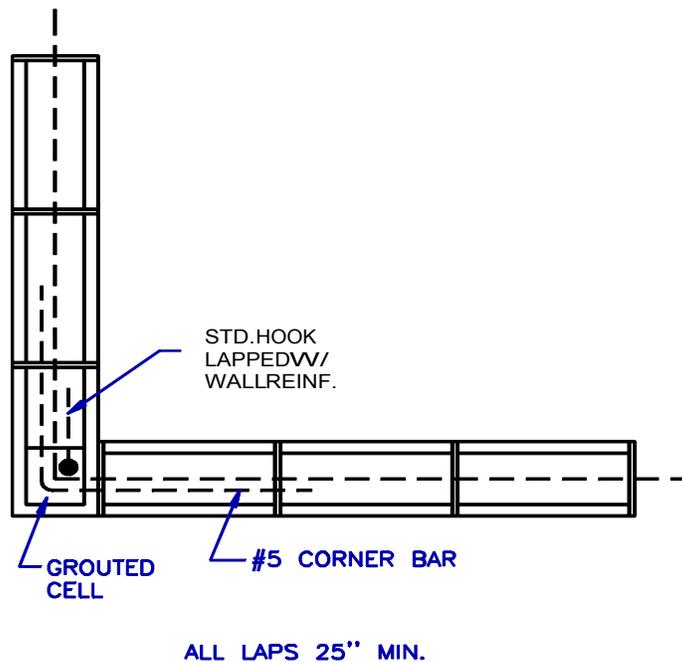

**FIGURE R609.5.4**  
**CORNER CONTINUITY OF BOND BEAM AND WALL REINFORCEMENT**

**R609.5.5 Change in height.** Changes in bond beam height shall be permitted as detailed in Figure R609.5.5.

**R609.5.6 Precast units reinforcement.** Precast bond beams shall properly receive and retain all vertical wall reinforcement. Precast bond beams shall contain the minimum amount of continuous reinforcement set forth in Section R609.5.2 and shall be reinforced at joints to act as drag struts and diaphragm chords.

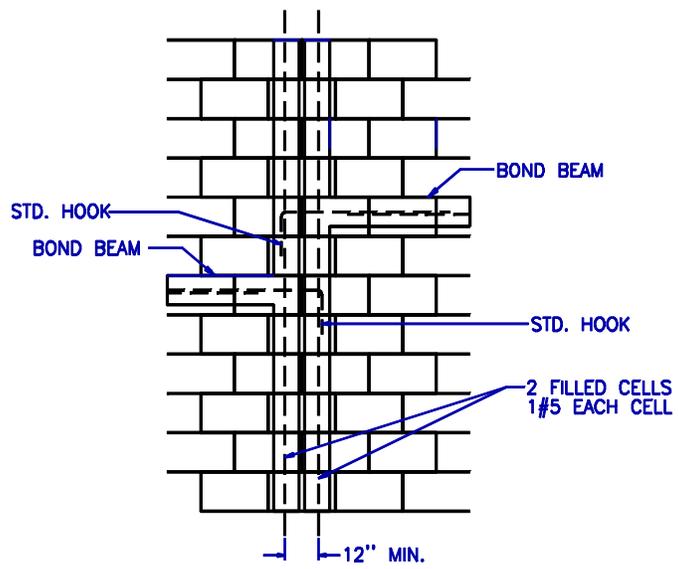

**FIGURE R609.5.5**  
**CHANGES IN BOND BEAM HEIGHT**

**TABLE R609.5.2A-1  
ROOF DIAPHRAGM CHORD TENSION BOND BEAM STEEL AREA, IN<sup>2</sup> GRADE 60**

Wind Vel.	Building Width	Wall Height	EXPOSURE B				
			BUILDING LENGTH				
			40	50	60	70	80
100	24	10	0.037	0.052	0.069	0.088	0.110
	24	8	0.030	0.042	0.055	0.071	0.088
	32	10	0.029	0.040	0.053	0.067	0.084
	32	8	0.023	0.032	0.042	0.054	0.067
	40	10	0.026	0.036	0.047	0.059	0.073
	40	8	0.021	0.029	0.037	0.047	0.058
110	24	10	0.045	0.063	0.084	0.107	0.133
	24	8	0.036	0.050	0.067	0.086	0.107
	32	10	0.035	0.048	0.064	0.082	0.101
	32	8	0.028	0.039	0.051	0.065	0.081
	40	10	0.032	0.043	0.057	0.072	0.088
	40	8	0.025	0.035	0.045	0.057	0.070
120	24	10	0.054	0.075	0.099	0.127	0.158
	24	8	0.043	0.060	0.080	0.102	0.127
	32	10	0.041	0.058	0.076	0.097	0.121
	32	8	0.033	0.046	0.061	0.078	0.097
	40	10	0.038	0.052	0.067	0.085	0.105
	40	8	0.030	0.041	0.054	0.068	0.084
130	24	10	0.063	0.088	0.117	0.149	0.186
	24	8	0.050	0.070	0.093	0.120	0.149
	32	10	0.049	0.068	0.089	0.114	0.142
	32	8	0.039	0.054	0.071	0.091	0.113
	40	10	0.044	0.061	0.079	0.100	0.123
	40	8	0.035	0.048	0.063	0.080	0.098
140	24	10	0.073	0.102	0.135	0.173	0.216
	24	8	0.058	0.082	0.108	0.139	0.173
	32	10	0.056	0.078	0.104	0.132	0.164
	32	8	0.045	0.063	0.083	0.106	0.131
	40	10	0.051	0.070	0.092	0.116	0.143
	40	8	0.041	0.056	0.073	0.093	0.114
150	24	10	0.084	0.117	0.155	0.199	0.248
	24	8	0.067	0.094	0.124	0.159	0.198
	32	10	0.065	0.090	0.119	0.152	0.189
	32	8	0.052	0.072	0.095	0.121	0.151
	40	10	0.059	0.081	0.105	0.133	0.164
	40	8	0.047	0.064	0.084	0.106	0.131

**Notes:**

1. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.
2. The tabular value for diaphragm chord tension steel area shall be reduced by a factor of 0.65 for bond beam spans located in the end zone.

**TABLE R609.5.2A-2  
ROOF DIAPHRAGM CHORD TENSION BOND BEAM STEEL AREA, IN<sup>2</sup> GRADE 60**

Wind Vel.	Building Width	Wall Height	EXPOSURE C				
			BUILDING LENGTH				
			40	50	60	70	80
100	24	10	0.052	0.073	0.097	0.124	0.154
	24	8	0.042	0.058	0.077	0.099	0.123
	32	10	0.040	0.056	0.074	0.095	0.118
	32	8	0.032	0.045	0.059	0.076	0.094
	40	10	0.037	0.050	0.066	0.083	0.102
	40	8	0.029	0.040	0.052	0.066	0.082
110	24	10	0.063	0.088	0.117	0.150	0.187
	24	8	0.051	0.071	0.094	0.120	0.149
	32	10	0.049	0.068	0.090	0.114	0.142
	32	8	0.039	0.054	0.072	0.092	0.114
	40	10	0.044	0.061	0.079	0.100	0.124
	40	8	0.035	0.049	0.063	0.080	0.099
120	24	10	0.075	0.105	0.139	0.178	0.222
	24	8	0.060	0.084	0.112	0.143	0.178
	32	10	0.058	0.081	0.107	0.136	0.169
	32	8	0.046	0.065	0.085	0.109	0.135
	40	10	0.053	0.072	0.094	0.119	0.147
	40	8	0.042	0.058	0.076	0.095	0.118
130	24	10	0.088	0.123	0.164	0.209	0.261
	24	8	0.071	0.099	0.131	0.168	0.209
	32	10	0.068	0.095	0.125	0.160	0.199
	32	8	0.055	0.076	0.100	0.128	0.159
	40	10	0.062	0.085	0.111	0.140	0.173
	40	8	0.050	0.068	0.089	0.112	0.138
140	24	10	0.102	0.143	0.190	0.243	0.302
	24	8	0.082	0.114	0.152	0.194	0.242
	32	10	0.079	0.110	0.145	0.185	0.230
	32	8	0.063	0.088	0.116	0.148	0.184
	40	10	0.072	0.098	0.129	0.162	0.200
	40	8	0.057	0.079	0.103	0.130	0.160
150	24	10	0.118	0.164	0.218	0.279	0.347
	24	8	0.094	0.131	0.174	0.223	0.278
	32	10	0.091	0.126	0.167	0.213	0.264
	32	8	0.073	0.101	0.133	0.170	0.212
	40	10	0.082	0.113	0.148	0.187	0.230
	40	8	0.066	0.090	0.118	0.149	0.184

**Notes:**

1. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel . Select appropriate bar size and number of bars from table r609.5.2C.
2. The tabular value for diaphragm chord tension steel area shall be reduced by a factor of 0.65 for bond beam spans located in the end zone.

**TABLE 609.5.2A-3  
ROOF DIAPHRAGM CHORD TENSION BOND BEAM STEEL AREA IN<sup>2</sup> GRADE 40**

Wind Vel.	Building Width	Wall Height	EXPOSURE B				
			BUILDING LENGTH				
			40	50	60	70	80
100	24	10	0.037	0.052	0.069	0.088	0.110
	24	8	0.030	0.042	0.055	0.071	0.088
	32	10	0.029	0.040	0.053	0.067	0.084
	32	8	0.023	0.032	0.042	0.054	0.067
	40	10	0.026	0.036	0.047	0.059	0.073
	40	8	0.021	0.029	0.037	0.047	0.058
110	24	10	0.045	0.063	0.084	0.107	0.133
	24	8	0.036	0.050	0.067	0.086	0.107
	32	10	0.035	0.048	0.064	0.082	0.101
	32	8	0.028	0.039	0.051	0.065	0.081
	40	10	0.032	0.043	0.057	0.072	0.088
	40	8	0.025	0.035	0.045	0.057	0.070
120	24	10	0.054	0.075	0.099	0.127	0.158
	24	8	0.043	0.060	0.080	0.102	0.127
	32	10	0.041	0.058	0.076	0.097	0.121
	32	8	0.033	0.046	0.061	0.078	0.097
	40	10	0.038	0.052	0.067	0.085	0.105
	40	8	0.030	0.041	0.054	0.068	0.084
130	24	10	0.063	0.088	0.117	0.149	0.186
	24	8	0.050	0.070	0.093	0.120	0.149
	32	10	0.049	0.068	0.089	0.114	0.142
	32	8	0.039	0.054	0.071	0.091	0.113
	40	10	0.044	0.061	0.079	0.100	0.123
	40	8	0.035	0.048	0.063	0.080	0.098
140	24	10	0.073	0.102	0.135	0.173	0.216
	24	8	0.058	0.082	0.108	0.139	0.173
	32	10	0.056	0.078	0.104	0.132	0.164
	32	8	0.045	0.063	0.083	0.106	0.131
	40	10	0.051	0.070	0.092	0.116	0.143
	40	8	0.041	0.056	0.073	0.093	0.114
150	24	10	0.084	0.117	0.155	0.199	0.248
	24	8	0.067	0.094	0.124	0.159	0.198
	32	10	0.065	0.090	0.119	0.152	0.189
	32	8	0.052	0.072	0.095	0.121	0.151
	40	10	0.059	0.081	0.105	0.133	0.164
	40	8	0.047	0.064	0.084	0.106	0.131

**Notes:**

1. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel . Select appropriate bar size and number of bars from table 609.5.2C.
2. The tabular value for diaphragm chord tension steel area shall be reduced by a factor of 0.65 for bond beam spans located in the end zone.

**TABLE 609.5.2A-4  
ROOF DIAPHRAGM CHORD TENSION BOND BEAM  
STEEL AREA IN<sup>2</sup> GRADE 40**

Wind Vel.	Building Width	Wall Height	EXPOSURE C				
			BUILDING LENGTH				
			40	50	60	70	80
100	24	10	0.052	0.073	0.097	0.124	0.154
	24	8	0.042	0.058	0.077	0.099	0.123
	32	10	0.040	0.056	0.074	0.095	0.118
	32	8	0.032	0.045	0.059	0.076	0.094
	40	10	0.037	0.050	0.066	0.083	0.102
	40	8	0.029	0.040	0.052	0.066	0.082
110	24	10	0.063	0.088	0.117	0.150	0.187
	24	8	0.051	0.071	0.094	0.120	0.149
	32	10	0.049	0.068	0.090	0.114	0.142
	32	8	0.039	0.054	0.072	0.092	0.114
	40	10	0.044	0.061	0.079	0.100	0.124
	40	8	0.035	0.049	0.063	0.080	0.099
120	24	10	0.075	0.105	0.139	0.178	0.222
	24	8	0.060	0.084	0.112	0.143	0.178
	32	10	0.058	0.081	0.107	0.136	0.169
	32	8	0.046	0.065	0.085	0.109	0.135
	40	10	0.053	0.072	0.094	0.119	0.147
	40	8	0.042	0.058	0.076	0.095	0.118
130	24	10	0.088	0.123	0.164	0.209	0.261
	24	8	0.071	0.099	0.131	0.168	0.209
	32	10	0.068	0.095	0.125	0.160	0.199
	32	8	0.055	0.076	0.100	0.128	0.159
	40	10	0.062	0.085	0.111	0.140	0.173
	40	8	0.050	0.068	0.089	0.112	0.138
140	24	10	0.102	0.143	0.190	0.243	0.302
	24	8	0.082	0.114	0.152	0.194	0.242
	32	10	0.079	0.110	0.145	0.185	0.230
	32	8	0.063	0.088	0.116	0.148	0.184
	40	10	0.072	0.098	0.129	0.162	0.200
	40	8	0.057	0.079	0.103	0.130	0.160
150	24	10	0.118	0.164	0.218	0.279	0.347
	24	8	0.094	0.131	0.174	0.223	0.278
	32	10	0.091	0.126	0.167	0.213	0.264
	32	8	0.073	0.101	0.133	0.170	0.212
	40	10	0.082	0.113	0.148	0.187	0.230
	40	8	0.066	0.090	0.118	0.149	0.184

**Notes:**

1. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel . Select appropriate bar size and number of bars from table 609.5.2C.
2. The tabular value for diaphragm chord tension steel area shall be reduced by a factor of 0.65 for bond beam spans located in the end zone.

**TABLE R609.5.2B-1**  
**AREA OF STEEL REQUIRED IN BOND BEAM FOR UPLIFT BENDING, IN<sup>2</sup> GRADE 60**

Uplift, plf	8 in. bond beam/lintel span, ft							
	4	6	8	10	12	14	16	18
50	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
100	0.009	0.021	0.038	0.060	0.088	0.123	NP	NP
150	0.016	0.037	0.067	0.107	0.159	NP	NP	NP
200	0.023	0.053	0.096	0.157	NP	NP	NP	NP
250	0.030	0.069	0.127	0.211	NP	NP	NP	NP
300	0.037	0.086	0.160	0.270	NP	NP	NP	NP
350	0.044	0.103	0.194	NP	NP	NP	NP	NP
400	0.051	0.120	0.230	NP	NP	NP	NP	NP
450	0.058	0.138	0.269	NP	NP	NP	NP	NP
500	0.065	0.156	NP	NP	NP	NP	NP	NP
550	0.073	0.175	NP	NP	NP	NP	NP	NP
600	0.080	0.195	NP	NP	NP	NP	NP	NP
650	0.088	0.215	NP	NP	NP	NP	NP	NP
700	0.095	0.235	NP	NP	NP	NP	NP	NP
750	0.103	0.257	NP	NP	NP	NP	NP	NP
800	0.110	0.280	NP	NP	NP	NP	NP	NP
850	0.118	NP						
900	0.126	NP						
950	0.134	NP						
1000	0.142	NP						
1050	0.150	NP						
1100	0.158	NP						

**Note:**

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE R609.5.2B-2**  
**AREA OF STEEL REQUIRED IN BOND BEAM FOR UPLIFT BENDING, IN<sup>2</sup> GRADE 60**

Uplift, plf	16 in. bond beam/lintel span, ft							
	4	6	8	10	12	14	16	18
50	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
100	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
150	0.005	0.010	0.019	0.029	0.042	0.058	0.076	0.097
200	0.007	0.017	0.030	0.046	0.067	0.092	0.121	0.154
250	0.010	0.023	0.040	0.063	0.092	0.126	0.167	0.214
300	0.013	0.029	0.051	0.081	0.117	0.162	0.214	0.275
350	0.015	0.035	0.062	0.098	0.143	0.197	0.262	NP
400	0.018	0.041	0.073	0.116	0.169	0.234	0.312	NP
450	0.021	0.047	0.084	0.134	0.195	0.271	NP	NP
500	0.023	0.053	0.096	0.152	0.222	0.309	NP	NP
550	0.026	0.059	0.107	0.170	0.249	0.348	NP	NP
600	0.029	0.066	0.118	0.188	0.277	0.388	NP	NP
650	0.032	0.072	0.130	0.206	0.305	0.429	NP	NP
700	0.034	0.078	0.141	0.225	0.334	NP	NP	NP
750	0.037	0.084	0.152	0.244	0.363	NP	NP	NP
800	0.040	0.091	0.164	0.263	0.392	NP	NP	NP
850	0.042	0.097	0.176	0.282	0.422	NP	NP	NP
900	0.045	0.103	0.187	0.302	0.453	NP	NP	NP
950	0.048	0.110	0.199	0.321	NP	NP	NP	NP
1000	0.051	0.116	0.211	0.341	NP	NP	NP	NP
1050	0.053	0.122	0.223	0.362	NP	NP	NP	NP
1100	0.056	0.129	0.235	0.382	NP	NP	NP	NP

Notes:

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE 609.5.2B-3  
AREA OF STEEL REQUIRED IN BOND BEAM FOR UPLIFT BENDING, IN<sup>2</sup> GRADE 60**

Uplift, plf	24 in. bond beam/lintel span, ft							
	4	6	8	10	12	14	16	18
50	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
100	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
150	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
200	0.004	0.008	0.014	0.022	0.032	0.043	0.057	0.072
250	0.005	0.012	0.021	0.032	0.047	0.064	0.084	0.106
300	0.007	0.015	0.027	0.043	0.062	0.085	0.111	0.142
350	0.009	0.019	0.034	0.054	0.077	0.106	0.139	0.177
400	0.010	0.023	0.041	0.064	0.093	0.127	0.167	0.213
450	0.012	0.027	0.048	0.075	0.108	0.148	0.195	0.249
500	0.014	0.031	0.054	0.086	0.124	0.170	0.224	0.286
550	0.015	0.034	0.061	0.096	0.140	0.192	0.253	0.323
600	0.017	0.038	0.068	0.107	0.155	0.213	0.282	0.361
650	0.019	0.042	0.075	0.118	0.171	0.235	0.311	0.399
700	0.020	0.046	0.082	0.129	0.187	0.257	0.341	0.438
750	0.022	0.050	0.089	0.140	0.203	0.280	0.371	0.477
800	0.024	0.053	0.095	0.150	0.219	0.302	0.401	0.517
850	0.025	0.057	0.102	0.161	0.235	0.325	0.432	0.558
900	0.027	0.061	0.109	0.172	0.251	0.347	0.462	NP
950	0.029	0.065	0.116	0.183	0.268	0.370	0.494	NP
1000	0.030	0.069	0.123	0.194	0.284	0.394	0.525	NP
1050	0.032	0.072	0.130	0.206	0.301	0.417	0.557	NP
1100	0.034	0.076	0.137	0.217	0.317	0.440	NP	NP

Notes:

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE R609.5.2B-4  
AREA OF STEEL REQUIRED IN BOND BEAM FOR UPLIFT BENDING, IN<sup>2</sup> GRADE 60**

Uplift, plf	32 in. bond beam/lintel span, ft							
	4	6	8	10	12	14	16	18
50	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
100	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
150	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
200	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
250	0.003	0.007	0.012	0.019	0.027	0.037	0.048	0.061
300	0.004	0.009	0.017	0.026	0.038	0.052	0.068	0.086
350	0.005	0.012	0.022	0.034	0.049	0.067	0.087	0.111
400	0.007	0.015	0.027	0.042	0.060	0.082	0.107	0.136
450	0.008	0.018	0.031	0.049	0.071	0.097	0.127	0.161
500	0.009	0.020	0.036	0.057	0.082	0.112	0.147	0.187
550	0.010	0.023	0.041	0.065	0.093	0.127	0.167	0.213
600	0.011	0.026	0.046	0.072	0.104	0.143	0.187	0.239
650	0.013	0.029	0.051	0.080	0.116	0.158	0.208	0.265
700	0.014	0.031	0.056	0.088	0.127	0.174	0.228	0.291
750	0.015	0.034	0.061	0.095	0.138	0.189	0.249	0.317
800	0.016	0.037	0.066	0.103	0.149	0.205	0.269	0.344
850	0.018	0.040	0.071	0.111	0.161	0.220	0.290	0.370
900	0.019	0.042	0.076	0.119	0.172	0.236	0.311	0.397
950	0.020	0.045	0.081	0.127	0.183	0.252	0.332	0.424
1000	0.021	0.048	0.085	0.134	0.195	0.267	0.353	0.451
1050	0.022	0.051	0.090	0.142	0.206	0.283	0.374	0.479
1100	0.024	0.053	0.095	0.150	0.218	0.299	0.395	0.506

Notes:

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE 609.5.2B-5  
AREA BOND BEAM/LINTEL UPLIFT STEEL DESIGN GRADE 40**

<b>Area of Steel Required in Bond Beam for Uplift Bending, in<sup>2</sup></b>								
<u>Uplift, plf</u>	<u>8 in. bond beam/lintel span, ft</u>							
	<u>4</u>	<u>6</u>	<u>8</u>	<u>10</u>	<u>12</u>	<u>14</u>	<u>16</u>	<u>18</u>
<u>50</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>
<u>100</u>	<u>0.014</u>	<u>0.032</u>	<u>0.057</u>	<u>0.090</u>	<u>0.132</u>	<u>0.184</u>	<u>NP</u>	<u>NP</u>
<u>150</u>	<u>0.024</u>	<u>0.055</u>	<u>0.100</u>	<u>0.160</u>	<u>0.239</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>200</u>	<u>0.034</u>	<u>0.079</u>	<u>0.144</u>	<u>0.235</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>250</u>	<u>0.045</u>	<u>0.103</u>	<u>0.191</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>300</u>	<u>0.055</u>	<u>0.128</u>	<u>0.240</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>350</u>	<u>0.066</u>	<u>0.154</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>400</u>	<u>0.076</u>	<u>0.180</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>450</u>	<u>0.087</u>	<u>0.207</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>500</u>	<u>0.098</u>	<u>0.234</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>550</u>	<u>0.109</u>	<u>0.263</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>	<u>NP</u>
<u>600</u>	<u>0.120</u>	<u>NP</u>						
<u>650</u>	<u>0.131</u>	<u>NP</u>						
<u>700</u>	<u>0.143</u>	<u>NP</u>						
<u>750</u>	<u>0.154</u>	<u>NP</u>						
<u>800</u>	<u>0.166</u>	<u>NP</u>						
<u>850</u>	<u>0.177</u>	<u>NP</u>						
<u>900</u>	<u>0.189</u>	<u>NP</u>						
<u>950</u>	<u>0.201</u>	<u>NP</u>						
<u>1000</u>	<u>0.213</u>	<u>NP</u>						
<u>1050</u>	<u>0.225</u>	<u>NP</u>						
<u>1100</u>	<u>0.238</u>	<u>NP</u>						

**Notes:**

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE 609.5.2B-6  
AREA BOND BEAM/LINTEL UPLIFT STEEL DESIGN GRADE 40**

<b>Area of Grade 40 Steel Required in Bond Beam for Uplift Bending, in<sup>2</sup></b>								
Uplift, plf	16 in. bond beam/lintel span, ft							
	4	6	8	10	12	14	16	18
50	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
100	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
150	0.007	0.016	0.028	0.044	0.063	0.087	0.114	0.145
200	0.011	0.025	0.044	0.069	0.101	0.138	0.181	0.231
250	0.015	0.034	0.061	0.095	0.138	0.190	0.250	0.320
300	0.019	0.043	0.077	0.121	0.176	0.242	0.321	0.413
350	0.023	0.052	0.093	0.147	0.215	0.296	0.393	NP
400	0.027	0.061	0.110	0.174	0.254	0.351	0.468	NP
450	0.031	0.071	0.127	0.200	0.293	0.407	NP	NP
500	0.035	0.080	0.143	0.227	0.333	0.464	NP	NP
550	0.039	0.089	0.160	0.254	0.374	0.523	NP	NP
600	0.043	0.098	0.177	0.282	0.415	0.583	NP	NP
650	0.047	0.108	0.194	0.310	0.458	0.644	NP	NP
700	0.051	0.117	0.211	0.338	0.500	NP	NP	NP
750	0.056	0.126	0.229	0.366	0.544	NP	NP	NP
800	0.060	0.136	0.246	0.394	0.588	NP	NP	NP
850	0.064	0.145	0.264	0.423	0.633	NP	NP	NP
900	0.068	0.155	0.281	0.453	0.679	NP	NP	NP
950	0.072	0.164	0.299	0.482	NP	NP	NP	NP
1000	0.076	0.174	0.317	0.512	NP	NP	NP	NP
1050	0.080	0.183	0.335	0.542	NP	NP	NP	NP
1100	0.084	0.193	0.353	0.573	NP	NP	NP	NP

Notes:

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE 609.5.2B-7  
AREA BOND BEAM/LINTEL UPLIFT STEEL DESIGN GRADE 40**

<b>Area of Grade40 Steel Required in Bond Beam for Uplift Bending, in<sup>2</sup></b>								
<u>Uplift, plf</u>	<u>24 in. bond beam/lintel span, ft</u>							
	<u>4</u>	<u>6</u>	<u>8</u>	<u>10</u>	<u>12</u>	<u>14</u>	<u>16</u>	<u>18</u>
<u>50</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>
<u>100</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>
<u>150</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>	<u>0.000</u>
<u>200</u>	<u>0.005</u>	<u>0.012</u>	<u>0.021</u>	<u>0.033</u>	<u>0.048</u>	<u>0.065</u>	<u>0.085</u>	<u>0.108</u>
<u>250</u>	<u>0.008</u>	<u>0.017</u>	<u>0.031</u>	<u>0.049</u>	<u>0.070</u>	<u>0.096</u>	<u>0.126</u>	<u>0.160</u>
<u>300</u>	<u>0.010</u>	<u>0.023</u>	<u>0.041</u>	<u>0.065</u>	<u>0.093</u>	<u>0.127</u>	<u>0.167</u>	<u>0.212</u>
<u>350</u>	<u>0.013</u>	<u>0.029</u>	<u>0.051</u>	<u>0.080</u>	<u>0.116</u>	<u>0.159</u>	<u>0.209</u>	<u>0.266</u>
<u>400</u>	<u>0.015</u>	<u>0.034</u>	<u>0.061</u>	<u>0.096</u>	<u>0.139</u>	<u>0.191</u>	<u>0.251</u>	<u>0.319</u>
<u>450</u>	<u>0.018</u>	<u>0.040</u>	<u>0.072</u>	<u>0.112</u>	<u>0.163</u>	<u>0.223</u>	<u>0.293</u>	<u>0.374</u>
<u>500</u>	<u>0.020</u>	<u>0.046</u>	<u>0.082</u>	<u>0.128</u>	<u>0.186</u>	<u>0.255</u>	<u>0.336</u>	<u>0.429</u>
<u>550</u>	<u>0.023</u>	<u>0.051</u>	<u>0.092</u>	<u>0.144</u>	<u>0.209</u>	<u>0.287</u>	<u>0.379</u>	<u>0.485</u>
<u>600</u>	<u>0.025</u>	<u>0.057</u>	<u>0.102</u>	<u>0.161</u>	<u>0.233</u>	<u>0.320</u>	<u>0.423</u>	<u>0.542</u>
<u>650</u>	<u>0.028</u>	<u>0.063</u>	<u>0.112</u>	<u>0.177</u>	<u>0.257</u>	<u>0.353</u>	<u>0.467</u>	<u>0.599</u>
<u>700</u>	<u>0.030</u>	<u>0.069</u>	<u>0.123</u>	<u>0.193</u>	<u>0.280</u>	<u>0.386</u>	<u>0.511</u>	<u>0.657</u>
<u>750</u>	<u>0.033</u>	<u>0.074</u>	<u>0.133</u>	<u>0.209</u>	<u>0.304</u>	<u>0.419</u>	<u>0.556</u>	<u>0.716</u>
<u>800</u>	<u>0.035</u>	<u>0.080</u>	<u>0.143</u>	<u>0.226</u>	<u>0.329</u>	<u>0.453</u>	<u>0.601</u>	<u>0.776</u>
<u>850</u>	<u>0.038</u>	<u>0.086</u>	<u>0.154</u>	<u>0.242</u>	<u>0.353</u>	<u>0.487</u>	<u>0.647</u>	<u>0.837</u>
<u>900</u>	<u>0.040</u>	<u>0.091</u>	<u>0.164</u>	<u>0.259</u>	<u>0.377</u>	<u>0.521</u>	<u>0.694</u>	<u>NP</u>
<u>950</u>	<u>0.043</u>	<u>0.097</u>	<u>0.174</u>	<u>0.275</u>	<u>0.402</u>	<u>0.556</u>	<u>0.741</u>	<u>NP</u>
<u>1000</u>	<u>0.045</u>	<u>0.103</u>	<u>0.185</u>	<u>0.292</u>	<u>0.426</u>	<u>0.590</u>	<u>0.788</u>	<u>NP</u>
<u>1050</u>	<u>0.048</u>	<u>0.109</u>	<u>0.195</u>	<u>0.308</u>	<u>0.451</u>	<u>0.625</u>	<u>0.836</u>	<u>NP</u>
<u>1100</u>	<u>0.051</u>	<u>0.114</u>	<u>0.205</u>	<u>0.325</u>	<u>0.476</u>	<u>0.661</u>	<u>NP</u>	<u>NP</u>

**Notes:**

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE 609.5.2B-8  
AREA BOND BEAM/LINTEL UPLIFT STEEL DESIGN GRADE 40**

Uplift, plf	Area of Grade 40 Steel Required in Bond Beam for Uplift Bending, in <sup>2</sup>							
	32 in. bond beam/lintel span, ft							
	4	6	8	10	12	14	16	18
50	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
100	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
150	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
200	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
250	0.004	0.010	0.018	0.028	0.040	0.055	0.072	0.091
300	0.006	0.014	0.025	0.039	0.057	0.077	0.101	0.129
350	0.008	0.018	0.033	0.051	0.073	0.100	0.131	0.166
400	0.010	0.022	0.040	0.062	0.090	0.123	0.161	0.204
450	0.012	0.026	0.047	0.074	0.107	0.145	0.191	0.242
500	0.014	0.031	0.054	0.085	0.123	0.168	0.221	0.281
550	0.015	0.035	0.062	0.097	0.140	0.191	0.251	0.319
600	0.017	0.039	0.069	0.108	0.157	0.214	0.281	0.358
650	0.019	0.043	0.077	0.120	0.173	0.237	0.312	0.397
700	0.021	0.047	0.084	0.132	0.190	0.260	0.342	0.436
750	0.023	0.051	0.091	0.143	0.207	0.284	0.373	0.476
800	0.025	0.055	0.099	0.155	0.224	0.307	0.404	0.515
850	0.026	0.059	0.106	0.166	0.241	0.330	0.435	0.556
900	0.028	0.064	0.113	0.178	0.258	0.354	0.466	0.596
950	0.030	0.068	0.121	0.190	0.275	0.377	0.497	0.636
1000	0.032	0.072	0.128	0.201	0.292	0.401	0.529	0.677
1050	0.034	0.076	0.136	0.213	0.309	0.425	0.561	0.718
1100	0.035	0.080	0.143	0.225	0.326	0.449	0.592	0.760

**Notes:**

1. When reinforcement required is 0.00, only diaphragm tension reinforcement is required.
2. Diaphragm chord tension steel area shall be added to bond beam uplift steel area for total required bond beam area of steel. Select appropriate bar size and number of bars from table 609.5.2C.

**TABLE 609.5.2C  
BOND BEAM AREA OF STEEL PROVIDED IN<sup>2</sup>/FT**

NUMBER OF BARS	BAR SIZE		
	NO. 4	No.	No.
		5	6
<u>1</u>	<u>0.20</u>	<u>0.31</u>	<u>0.44</u>
<u>2</u>	<u>0.40</u>	<u>0.62</u>	<u>0.88</u>

**R609.6 Vertical reinforcement.** Vertical reinforcement shall be provided in conformance with Sections R609.6.1 through R609.6.6.

**R609.6. Corner reinforcement.** One reinforcement bar shall be provided in each corner, including interior corners and corners created by changes in wall direction or offsetting of walls.

**R609.6.2 Openings.** A minimum of one bar of the size used for vertical wall reinforcement shall be provided on each side of openings wider than 6 feet. If more vertical reinforcement is interrupted by an opening than is provided beside the opening (total in the first and second cells adjacent to the opening), one-half of the equivalent area of reinforcement interrupted by the opening shall be placed on each side of the opening. This reinforcement shall be placed within the first and/or second cells beside the opening.

**R609.6.2 Girders.** At least one reinforcement bar shall be provided where girders or girder trusses bear on masonry walls.

**R609.6.3 Spacing.** Vertical reinforcement shall be provided as set forth in Tables R609.6.3A-1, R609.6.3A-2, R609.6.3B-1, R609.6.3B-2, R609.6.3B-3, and R609.6.3B-4 as applicable.

**R609.6.4 Precast bond beams.** Vertical reinforcement used in conjunction with precast bond beams shall be spaced the same as for masonry bond beams. Reinforcement shall terminate in the precast beam as set forth in Section R606.9.8.

**R609.6.5 Duplication.** Reinforcing steel requirements shall not be additive. A single bar shall be permitted to satisfy multiple requirements.

**R609.6.6 Termination.** Vertical reinforcement shall terminate in footings and bond beams as set forth in Section R606.16.7.

**TABLE R609.6.3A-1  
GRADE 60 SINGLE STORY AND TOP STORY WALLS PARALLEL TO RIDGE VERTICAL  
REINFORCEMENT SPACING No. 5 (<sup>5</sup>/<sub>8</sub>" ) BARS**

		Exposure	B	B	B	C	C	C
		Building Width						
<u>Wind Velocity</u> <u>100</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	
	<u>8.00</u>	<u>9.87</u>	<u>9.87</u>	<u>9.87</u>	<u>8.34</u>	<u>8.34</u>	<u>8.34</u>	
	<u>8.67</u>	<u>9.97</u>	<u>9.97</u>	<u>9.97</u>	<u>8.42</u>	<u>8.42</u>	<u>8.42</u>	
	<u>9.33</u>	<u>10.06</u>	<u>10.06</u>	<u>10.06</u>	<u>8.49</u>	<u>8.49</u>	<u>8.49</u>	
	<u>10.00</u>	<u>10.14</u>	<u>10.14</u>	<u>10.14</u>	<u>8.57</u>	<u>8.57</u>	<u>8.54</u>	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u> <u>110</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	
	<u>8.00</u>	<u>8.97</u>	<u>8.97</u>	<u>8.97</u>	<u>7.58</u>	<u>7.58</u>	<u>7.58</u>	
	<u>8.67</u>	<u>9.06</u>	<u>9.06</u>	<u>9.06</u>	<u>7.65</u>	<u>7.65</u>	<u>7.65</u>	
	<u>9.33</u>	<u>9.14</u>	<u>9.14</u>	<u>9.14</u>	<u>7.72</u>	<u>7.72</u>	<u>7.72</u>	
	<u>10.00</u>	<u>9.22</u>	<u>9.22</u>	<u>9.22</u>	<u>7.79</u>	<u>7.79</u>	<u>7.79</u>	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u> <u>120</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	
	<u>8.00</u>	<u>8.23</u>	<u>8.23</u>	<u>8.23</u>	<u>6.95</u>	<u>6.95</u>	<u>6.95</u>	
	<u>8.67</u>	<u>8.30</u>	<u>8.30</u>	<u>8.30</u>	<u>7.01</u>	<u>7.01</u>	<u>7.01</u>	
	<u>9.33</u>	<u>8.38</u>	<u>8.38</u>	<u>8.38</u>	<u>7.08</u>	<u>7.08</u>	<u>7.08</u>	
	<u>10.00</u>	<u>8.45</u>	<u>8.45</u>	<u>8.45</u>	<u>6.87</u>	<u>6.87</u>	<u>6.87</u>	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u> <u>130</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	
	<u>8.00</u>	<u>7.59</u>	<u>7.59</u>	<u>7.59</u>	<u>6.41</u>	<u>6.41</u>	<u>6.21</u>	
	<u>8.67</u>	<u>7.67</u>	<u>7.67</u>	<u>7.67</u>	<u>6.47</u>	<u>6.14</u>	<u>5.67</u>	
	<u>9.33</u>	<u>7.73</u>	<u>7.73</u>	<u>7.57</u>	<u>6.03</u>	<u>5.58</u>	<u>5.19</u>	
	<u>10.00</u>	<u>7.80</u>	<u>7.36</u>	<u>6.90</u>	<u>5.44</u>	<u>5.07</u>	<u>4.74</u>	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u> <u>140</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	
	<u>8.00</u>	<u>7.05</u>	<u>7.05</u>	<u>7.05</u>	<u>5.95</u>	<u>5.76</u>	<u>5.27</u>	
	<u>8.67</u>	<u>7.12</u>	<u>7.12</u>	<u>7.01</u>	<u>5.70</u>	<u>5.22</u>	<u>4.82</u>	
	<u>9.33</u>	<u>7.18</u>	<u>6.88</u>	<u>6.40</u>	<u>5.14</u>	<u>4.75</u>	<u>4.41</u>	
	<u>10.00</u>	<u>6.70</u>	<u>6.24</u>	<u>5.85</u>	<u>4.64</u>	<u>4.32</u>	<u>4.04</u>	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u> <u>150</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	
	<u>8.00</u>	<u>6.58</u>	<u>6.58</u>	<u>6.58</u>	<u>5.46</u>	<u>4.96</u>	<u>4.54</u>	
	<u>8.67</u>	<u>6.64</u>	<u>6.50</u>	<u>6.01</u>	<u>4.91</u>	<u>4.50</u>	<u>4.15</u>	
	<u>9.33</u>	<u>6.39</u>	<u>5.91</u>	<u>5.49</u>	<u>4.43</u>	<u>4.09</u>	<u>3.80</u>	
	<u>10.00</u>	<u>5.76</u>	<u>5.37</u>	<u>5.02</u>	<u>4.00</u>	<u>3.72</u>	<u>3.48</u>	

**TABLE R609.6.3A-1 continued**  
**GRADE 60 SINGLE STORY AND TOP STORY WALLS PARALLEL TO RIDGE VERTICAL REINFORCEMENT**  
**SPACING No. 4 (1/2") BARS**

<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>					
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>
<u>100</u>	<u>8.00</u>	<u>9.87</u>	<u>9.87</u>	<u>9.87</u>	<u>8.34</u>	<u>7.97</u>	<u>7.32</u>
	<u>8.67</u>	<u>9.97</u>	<u>9.97</u>	<u>9.97</u>	<u>7.79</u>	<u>7.17</u>	<u>6.65</u>
	<u>9.33</u>	<u>10.06</u>	<u>9.69</u>	<u>9.08</u>	<u>6.98</u>	<u>6.48</u>	<u>6.05</u>
	<u>10.00</u>	<u>9.06</u>	<u>8.72</u>	<u>8.22</u>	<u>6.27</u>	<u>5.87</u>	<u>5.51</u>
<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>					
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>
<u>110</u>	<u>8.00</u>	<u>8.97</u>	<u>8.97</u>	<u>8.76</u>	<u>7.01</u>	<u>6.38</u>	<u>5.85</u>
	<u>8.67</u>	<u>9.06</u>	<u>9.06</u>	<u>9.06</u>	<u>6.83</u>	<u>6.83</u>	<u>6.83</u>
	<u>9.33</u>	<u>8.45</u>	<u>8.45</u>	<u>8.45</u>	<u>5.99</u>	<u>5.99</u>	<u>5.99</u>
	<u>10.00</u>	<u>7.47</u>	<u>7.47</u>	<u>7.47</u>	<u>5.30</u>	<u>5.30</u>	<u>5.30</u>
<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>					
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>
<u>120</u>	<u>8.00</u>	<u>8.23</u>	<u>7.72</u>	<u>7.09</u>	<u>5.75</u>	<u>5.23</u>	<u>4.80</u>
	<u>8.67</u>	<u>8.07</u>	<u>8.07</u>	<u>8.07</u>	<u>5.72</u>	<u>5.72</u>	<u>5.72</u>
	<u>9.33</u>	<u>7.08</u>	<u>7.08</u>	<u>7.08</u>	<u>5.02</u>	<u>5.02</u>	<u>5.02</u>
	<u>10.00</u>	<u>6.26</u>	<u>6.26</u>	<u>6.26</u>	<u>4.43</u>	<u>4.43</u>	<u>4.43</u>
<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>					
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>
<u>130</u>	<u>8.00</u>	<u>7.04</u>	<u>6.41</u>	<u>5.88</u>	<u>4.82</u>	<u>4.38</u>	<u>4.01</u>
	<u>8.67</u>	<u>6.29</u>	<u>5.78</u>	<u>5.35</u>	<u>4.32</u>	<u>3.96</u>	<u>3.66</u>
	<u>9.33</u>	<u>5.65</u>	<u>5.24</u>	<u>4.88</u>	<u>3.89</u>	<u>3.60</u>	<u>3.35</u>
	<u>10.00</u>	<u>5.09</u>	<u>4.75</u>	<u>4.45</u>	<u>3.51</u>	<u>3.27</u>	<u>3.06</u>
<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>					
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>
<u>140</u>	<u>8.00</u>	<u>7.05</u>	<u>7.05</u>	<u>7.05</u>	<u>5.95</u>	<u>5.76</u>	<u>5.27</u>
	<u>8.67</u>	<u>7.12</u>	<u>7.12</u>	<u>7.01</u>	<u>5.70</u>	<u>5.22</u>	<u>4.82</u>
	<u>9.33</u>	<u>7.18</u>	<u>6.88</u>	<u>6.40</u>	<u>5.14</u>	<u>4.75</u>	<u>4.41</u>
	<u>10.00</u>	<u>6.70</u>	<u>6.24</u>	<u>5.85</u>	<u>4.64</u>	<u>4.32</u>	<u>4.04</u>
<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>					
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>
<u>150</u>	<u>8.00</u>	<u>6.58</u>	<u>6.58</u>	<u>6.58</u>	<u>5.46</u>	<u>4.96</u>	<u>4.54</u>
	<u>8.67</u>	<u>6.64</u>	<u>6.50</u>	<u>6.01</u>	<u>4.91</u>	<u>4.50</u>	<u>4.15</u>
	<u>9.33</u>	<u>6.39</u>	<u>5.91</u>	<u>5.49</u>	<u>4.43</u>	<u>4.09</u>	<u>3.80</u>
	<u>10.00</u>	<u>5.76</u>	<u>5.37</u>	<u>5.02</u>	<u>4.00</u>	<u>3.72</u>	<u>3.48</u>

**TABLE R609.3A-2  
GRADE 40 SINGLE STORY AND TOP STORY WALLS PARALLEL TO RIDGE VERTICAL  
REINFORCEMENT SPACING No. 5 (5/8") BARS**

		<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>							
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>
<b>100</b>	8.00	9.87	9.87	9.87	8.34	8.23	7.57		
	8.67	9.97	9.97	9.97	8.05	7.41	6.87		
	9.33	10.06	10.01	9.38	7.22	6.70	6.25		
	10.00	9.36	9.01	8.49	6.48	6.06	5.69		
		<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>							
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>
<b>110</b>	8.00	8.97	8.97	8.97	7.24	6.59	6.05		
	8.67	9.06	9.06	9.06	7.06	7.06	7.06		
	9.33	8.73	8.73	8.73	6.19	6.19	6.19		
	10.00	7.72	7.72	7.72	5.47	5.47	5.47		
		<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>							
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>
<b>120</b>	8.00	8.23	7.98	7.33	5.95	5.41	4.96		
	8.67	8.30	8.30	8.30	5.92	5.92	5.92		
	9.33	7.32	7.32	7.32	5.19	5.19	5.19		
	10.00	6.47	6.47	6.47	4.58	4.58	4.58		
		<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>							
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>
<b>130</b>	8.00	7.27	6.62	6.07	4.98	4.52	4.14		
	8.67	6.50	5.98	5.53	4.47	4.10	3.78		
	9.33	5.84	5.41	5.04	4.02	3.72	3.46		
	10.00	5.26	4.91	4.60	3.63	3.38	3.16		
		<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>							
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>
<b>140</b>	8.00	6.15	5.59	5.13	4.23	3.84	3.52		
	8.67	5.51	5.06	4.67	3.80	3.48	3.21		
	9.33	4.95	4.59	4.27	3.43	3.17	2.94		
	10.00	4.46	4.16	3.90	3.09	2.88	2.69		
		<u>Exposure</u>		<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>							
<u>Wind Velocity</u>	<u>Wall Height</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>	<u>40</u>	<u>24</u>	<u>32</u>
<b>150</b>	8.00	5.27	4.79	4.39	3.64	3.31	3.02		
	8.67	4.73	4.34	4.00	3.27	3.00	2.76		
	9.33	4.26	3.94	3.66	2.95	2.73	2.53		
	10.00	3.84	3.58	3.35	2.66	2.48	2.32		

**TABLE R609.3A-2 continued**  
**GRADE 40 SINGLE STORY AND TOP STORY WALLS PARALLEL TO RIDGE VERTICAL REINFORCEMENT**  
**SPACING No. 4 (½") BARS**

		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u>	<u>Wall Height</u>	24	32	40	24	32	40	
<b><u>100</u></b>	8.00	8.78	8.04	7.42	5.82	5.31	4.88	
	8.67	7.77	7.19	6.69	5.19	4.78	4.43	
	9.33	6.83	6.46	6.05	4.66	4.32	4.03	
	10.00	6.04	5.81	5.48	4.18	3.91	3.67	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u>	<u>Wall Height</u>	24	32	40	24	32	40	
<b><u>110</u></b>	8.00	6.94	6.34	5.84	4.67	4.25	3.90	
	8.67	6.42	6.42	6.42	4.56	4.56	4.56	
	9.33	5.63	5.63	5.63	4.00	4.00	4.00	
	10.00	4.98	4.98	4.98	3.53	3.53	3.53	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u>	<u>Wall Height</u>	24	32	40	24	32	40	
<b><u>120</u></b>	8.00	5.64	5.15	4.73	3.84	3.49	3.20	
	8.67	5.38	5.38	5.38	3.82	3.82	3.82	
	9.33	4.72	4.72	4.72	3.35	3.35	3.35	
	10.00	4.17	4.17	4.17	2.95	2.95	2.95	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u>	<u>Wall Height</u>	24	32	40	24	32	40	
<b><u>130</u></b>	8.00	4.69	4.27	3.92	3.21	2.92	2.67	
	8.67	4.19	3.86	3.57	2.88	2.64	2.44	
	9.33	3.77	3.49	3.25	2.60	2.40	2.23	
	10.00	3.39	3.17	2.97	2.34	2.18	2.04	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u>	<u>Wall Height</u>	24	32	40	24	32	40	
<b><u>140</u></b>	8.00	6.15	5.59	5.13	4.23	3.84	3.52	
	8.67	5.51	5.06	4.67	3.80	3.48	3.21	
	9.33	4.95	4.59	4.27	3.43	3.17	2.94	
	10.00	4.46	4.16	3.90	3.09	2.88	2.69	
		<u>Exposure</u>	<u>B</u>	<u>B</u>	<u>B</u>	<u>C</u>	<u>C</u>	<u>C</u>
		<u>Building Width</u>						
<u>Wind Velocity</u>	<u>Wall Height</u>	24	32	40	24	32	40	
<b><u>150</u></b>	8.00	5.27	4.79	4.39	3.64	3.31	3.02	
	8.67	4.73	4.34	4.00	3.27	3.00	2.76	
	9.33	4.26	3.94	3.66	2.95	2.73	2.53	
	10.00	3.84	3.58	3.35	2.66	2.48	2.32	

**TABLE R609.6.3B-1**  
**GRADE 60 MAXIMUM SPACING OF No. 5 ( $\frac{5}{8}$ " ) VERTICAL REINFORCEMENT AT CONTINUOUS CONCRETE**  
**MASONRY LOWER STORIES OF MULTISTORY AND GABLE ENDS SINGLE STORY OR TOP STORY OF**  
**MULTISTORY, FEET**

Wind Velocity		100		110		120	
Exp	Wall hgt	End Zone	Int Zone	End Zone	Int Zone	End Zone	Int Zone
B	8	9.87	10.53	8.97	9.57	8.23	8.78
	8.67	9.97	10.59	9.06	9.63	8.30	8.82
	9.33	10.06	10.64	9.14	9.68	8.38	8.87
	10	10.14	10.69	9.22	9.72	8.45	8.91
	12	10.17	10.83	8.38	9.14	7.01	7.65
	14	7.75	8.29	6.37	6.82	5.33	5.70
	16	6.12	6.43	5.03	5.29	4.19	4.41
	18	4.97	5.14	4.07	4.21	3.39	3.51
	20	4.12	4.20	3.38	3.44	2.81	2.86
	22	3.48	3.49	2.84	2.85	2.36	2.36
	C	8	8.34	8.89	7.58	8.09	6.95
8.67		8.42	8.94	7.65	8.13	7.01	7.45
9.33		8.49	8.99	7.72	8.17	7.08	7.49
10		8.57	9.03	7.79	8.21	6.87	7.53
12		7.21	7.86	5.92	6.47	4.95	5.40
14		5.47	5.86	4.49	4.81	3.75	4.01
16		4.31	4.54	3.53	3.72	2.94	3.09
18		3.49	3.61	2.85	2.95	2.37	2.45
20		2.89	2.94	2.35	2.40	1.94	1.98
22		2.43	2.43	1.97	1.98	1.62	1.63

Wind Velocity		130		140		150	
Exp	Wall hgt	End Zone	Int Zone	End Zone	Int Zone	End Zone	Int Zone
B	8	7.59	8.10	7.05	7.52	6.58	7.02
	8.67	7.67	8.15	7.12	7.56	6.64	7.06
	9.33	7.73	8.19	7.18	7.60	6.70	7.10
	10	7.80	8.23	7.08	7.64	6.14	6.85
	12	5.95	6.49	5.10	5.57	4.42	4.83
	14	4.51	4.83	3.86	4.14	3.34	3.58
	16	3.55	3.73	3.03	3.19	2.62	2.76
	18	2.86	2.96	2.44	2.53	2.10	2.18
	20	2.36	2.41	2.01	2.05	1.72	1.76
	22	1.98	1.99	1.68	1.68	1.43	1.44
	C	8	6.41	6.84	5.95	6.35	5.56
8.67		6.47	6.88	6.01	6.39	5.24	5.96
9.33		6.52	6.91	5.53	6.37	4.75	5.53
10		5.83	6.50	5.00	5.58	4.31	4.84
12		4.19	4.58	3.59	3.92	3.10	3.39
14		3.16	3.39	2.70	2.90	2.33	2.50
16		2.47	2.61	2.11	2.22	1.81	1.91
18		1.99	2.06	1.68	1.75	1.44	1.49
20		1.63	1.66	1.37	1.40	1.16	1.19
22		1.35	1.35	1.13	1.14	1.03	1.26

**TABLE R609.6.3B-2**  
**GRADE 60 MAXIMUM SPACING OF No. 4 (1/2") VERTICAL REINFORCEMENT AT CONTINUOUS**  
**CONCRETE MASONRY LOWER STORIES OF MULTISTORY AND GABLE ENDS SINGLE STORY OR TOP**  
**STORY OF MULTISTORY, FEET**

<u>Wind Velocity</u>		<u>100</u>		<u>110</u>		<u>120</u>	
<u>Exp</u>	<u>Wall hgt</u>	<u>End Zone</u>	<u>Int Zone</u>	<u>End Zone</u>	<u>Int Zone</u>	<u>End Zone</u>	<u>Int Zone</u>
<u>B</u>	<u>8</u>	<u>9.87</u>	<u>10.53</u>	<u>8.97</u>	<u>9.57</u>	<u>8.23</u>	<u>8.78</u>
	<u>8.67</u>	<u>9.97</u>	<u>10.59</u>	<u>9.06</u>	<u>9.63</u>	<u>8.07</u>	<u>8.82</u>
	<u>9.33</u>	<u>10.06</u>	<u>10.64</u>	<u>8.45</u>	<u>9.48</u>	<u>7.08</u>	<u>7.95</u>
	<u>10</u>	<u>9.06</u>	<u>10.09</u>	<u>7.47</u>	<u>8.32</u>	<u>6.26</u>	<u>6.97</u>
	<u>12</u>	<u>6.56</u>	<u>7.16</u>	<u>5.40</u>	<u>5.89</u>	<u>4.52</u>	<u>4.93</u>
	<u>14</u>	<u>5.00</u>	<u>5.35</u>	<u>4.11</u>	<u>4.40</u>	<u>3.44</u>	<u>3.68</u>
	<u>16</u>	<u>3.95</u>	<u>4.15</u>	<u>3.24</u>	<u>3.41</u>	<u>2.71</u>	<u>2.85</u>
	<u>18</u>	<u>3.21</u>	<u>3.31</u>	<u>2.63</u>	<u>2.72</u>	<u>2.19</u>	<u>2.27</u>
	<u>20</u>	<u>2.66</u>	<u>2.71</u>	<u>2.18</u>	<u>2.22</u>	<u>1.81</u>	<u>1.84</u>
	<u>22</u>	<u>2.25</u>	<u>2.25</u>	<u>1.83</u>	<u>1.84</u>	<u>1.52</u>	<u>1.53</u>
<u>C</u>	<u>8</u>	<u>8.34</u>	<u>8.89</u>	<u>7.58</u>	<u>8.09</u>	<u>6.20</u>	<u>7.41</u>
	<u>8.67</u>	<u>8.29</u>	<u>8.94</u>	<u>6.83</u>	<u>7.73</u>	<u>5.58</u>	<u>6.48</u>
	<u>9.33</u>	<u>7.28</u>	<u>8.17</u>	<u>5.99</u>	<u>6.73</u>	<u>5.02</u>	<u>5.64</u>
	<u>10</u>	<u>6.43</u>	<u>7.16</u>	<u>5.30</u>	<u>5.90</u>	<u>4.43</u>	<u>4.94</u>
	<u>12</u>	<u>4.65</u>	<u>5.07</u>	<u>3.82</u>	<u>4.17</u>	<u>3.19</u>	<u>3.49</u>
	<u>14</u>	<u>3.53</u>	<u>3.78</u>	<u>2.90</u>	<u>3.10</u>	<u>2.42</u>	<u>2.59</u>
	<u>16</u>	<u>2.78</u>	<u>2.93</u>	<u>2.28</u>	<u>2.40</u>	<u>1.90</u>	<u>2.00</u>
	<u>18</u>	<u>2.25</u>	<u>2.33</u>	<u>1.84</u>	<u>1.90</u>	<u>1.53</u>	<u>1.58</u>
	<u>20</u>	<u>1.86</u>	<u>1.90</u>	<u>1.52</u>	<u>1.55</u>	<u>1.25</u>	<u>1.28</u>
	<u>22</u>	<u>1.57</u>	<u>1.57</u>	<u>1.27</u>	<u>1.28</u>	<u>1.05</u>	<u>1.05</u>

<u>Wind Velocity</u>		<u>130</u>		<u>140</u>		<u>150</u>	
<u>Exp</u>	<u>Wall hgt</u>	<u>End Zone</u>	<u>Int Zone</u>	<u>End Zone</u>	<u>Int Zone</u>	<u>End Zone</u>	<u>Int Zone</u>
<u>B</u>	<u>8</u>	<u>7.59</u>	<u>8.10</u>	<u>6.42</u>	<u>7.52</u>	<u>5.47</u>	<u>6.68</u>
	<u>8.67</u>	<u>6.86</u>	<u>7.76</u>	<u>5.77</u>	<u>6.68</u>	<u>4.93</u>	<u>5.80</u>
	<u>9.33</u>	<u>6.02</u>	<u>6.76</u>	<u>5.17</u>	<u>5.81</u>	<u>4.46</u>	<u>5.05</u>
	<u>10</u>	<u>5.32</u>	<u>5.92</u>	<u>4.57</u>	<u>5.09</u>	<u>3.96</u>	<u>4.42</u>
	<u>12</u>	<u>3.84</u>	<u>4.19</u>	<u>3.29</u>	<u>3.59</u>	<u>2.85</u>	<u>3.12</u>
	<u>14</u>	<u>2.91</u>	<u>3.12</u>	<u>2.49</u>	<u>2.67</u>	<u>2.16</u>	<u>2.31</u>
	<u>16</u>	<u>2.29</u>	<u>2.41</u>	<u>1.96</u>	<u>2.06</u>	<u>1.69</u>	<u>1.78</u>
	<u>18</u>	<u>1.85</u>	<u>1.91</u>	<u>1.58</u>	<u>1.63</u>	<u>1.36</u>	<u>1.41</u>
	<u>20</u>	<u>1.52</u>	<u>1.55</u>	<u>1.30</u>	<u>1.32</u>	<u>1.11</u>	<u>1.13</u>
	<u>22</u>	<u>1.28</u>	<u>1.28</u>	<u>1.08</u>	<u>1.09</u>	<u>0.93</u>	<u>0.93</u>
<u>C</u>	<u>8</u>	<u>5.15</u>	<u>6.29</u>	<u>4.36</u>	<u>5.30</u>	<u>3.73</u>	<u>4.53</u>
	<u>8.67</u>	<u>4.65</u>	<u>5.50</u>	<u>3.94</u>	<u>4.73</u>	<u>3.38</u>	<u>4.09</u>
	<u>9.33</u>	<u>4.21</u>	<u>4.79</u>	<u>3.57</u>	<u>4.11</u>	<u>3.06</u>	<u>3.57</u>
	<u>10</u>	<u>3.76</u>	<u>4.19</u>	<u>3.22</u>	<u>3.60</u>	<u>2.78</u>	<u>3.12</u>
	<u>12</u>	<u>2.70</u>	<u>2.95</u>	<u>2.31</u>	<u>2.53</u>	<u>2.00</u>	<u>2.19</u>
	<u>14</u>	<u>2.04</u>	<u>2.19</u>	<u>1.74</u>	<u>1.87</u>	<u>1.50</u>	<u>1.61</u>
	<u>16</u>	<u>1.60</u>	<u>1.68</u>	<u>1.36</u>	<u>1.43</u>	<u>1.17</u>	<u>1.23</u>
	<u>18</u>	<u>1.28</u>	<u>1.33</u>	<u>1.09</u>	<u>1.13</u>	<u>0.93</u>	<u>0.96</u>
	<u>20</u>	<u>1.05</u>	<u>1.07</u>	<u>0.88</u>	<u>0.90</u>	<u>0.75</u>	<u>0.77</u>
	<u>22</u>	<u>0.87</u>	<u>0.87</u>	<u>0.73</u>	<u>0.73</u>	<u>0.67</u>	<u>0.81</u>

**TABLE R609.6.3B-3**  
**GRADE 40 MAXIMUM SPACING OF No. 5 ( $\frac{5}{8}$ " ) VERTICAL REINFORCEMENT AT CONTINUOUS CONCRETE**  
**MASONRY LOWER STORIES OF MULTISTORY AND GABLE ENDS SINGLE STORY OR TOP STORY OF**  
**MULTISTORY, FEET**

Wind Velocity		100		110		120	
Exp	Wall hgt	End Zone	Int Zone	End Zone	Int Zone	End Zone	Int Zone
B	8	9.87	10.53	8.97	9.57	8.23	8.78
	8.67	9.97	10.59	9.06	9.63	8.30	8.82
	9.33	10.06	10.64	8.73	9.68	7.32	8.21
	10	9.36	10.42	7.72	8.60	6.47	7.20
	12	6.78	7.39	5.58	6.09	4.67	5.10
	14	5.16	5.53	4.25	4.55	3.55	3.80
	16	4.08	4.29	3.35	3.52	2.80	2.94
	18	3.31	3.43	2.72	2.81	2.26	2.34
	20	2.75	2.80	2.25	2.29	1.87	1.90
	22	2.32	2.33	1.90	1.90	1.57	1.58
		-	-	-	-	-	-
C	8	8.34	8.89	7.58	8.09	6.40	7.41
	8.67	8.42	8.94	7.06	7.99	5.77	6.69
	9.33	7.52	8.44	6.19	6.95	5.19	5.82
	10	6.65	7.40	5.47	6.10	4.58	5.10
	12	4.80	5.24	3.95	4.31	3.30	3.60
	14	3.65	3.91	3.00	3.21	2.50	2.68
	16	2.88	3.02	2.35	2.48	1.96	2.06
	18	2.33	2.41	1.90	1.97	1.58	1.63
	20	1.92	1.96	1.57	1.60	1.30	1.32
	22	1.62	1.62	1.31	1.32	1.08	1.09

Wind Velocity		130		140		150	
Exp	Wall hgt	End Zone	Int Zone	End Zone	Int Zone	End Zone	Int Zone
B	8	7.59	8.10	6.63	7.52	5.65	6.91
	8.67	7.09	8.02	5.97	6.90	5.09	5.99
	9.33	6.22	6.98	5.35	6.00	4.61	5.21
	10	5.49	6.12	4.72	5.26	4.10	4.57
	12	3.96	4.33	3.40	3.71	2.95	3.22
	14	3.01	3.22	2.58	2.76	2.23	2.39
	16	2.36	2.49	2.02	2.13	1.74	1.84
	18	1.91	1.98	1.63	1.69	1.40	1.45
	20	1.57	1.60	1.34	1.36	1.15	1.17
	22	1.32	1.32	1.12	1.12	0.00	0.00
		-	-	-	-	-	-
C	8	5.32	6.50	4.50	5.47	3.86	4.68
	8.67	4.80	5.69	4.07	4.89	3.49	4.22
	9.33	4.35	4.95	3.69	4.25	3.17	3.68
	10	3.88	4.33	3.33	3.72	2.87	3.22
	12	2.79	3.05	2.39	2.61	2.07	2.26
	14	2.11	2.26	1.80	1.93	1.55	1.67
	16	1.65	1.74	1.40	1.48	1.21	1.27
	18	1.32	1.37	1.12	1.16	0.00	0.00
	20	1.08	1.10	0.00	0.00	0.00	0.00
	22	0.00	0.00	0.00	0.00	0.00	0.00

**TABLE R609.6.3B-4**  
**GRADE 40 MAXIMUM SPACING OF NO. 4 (1/2") VERTICAL REINFORCEMENT AT CONTINUOUS**  
**CONCRETE OR MASONRY LOWER STORIES OF MULTISTORY AND GABLE ENDS SINGLE STORY OR**  
**TOP STORY OF MULTISTORY, FEET**

Wind Velocity		100		110		120	
Exp	Wall hgt	End Zone	Int Zone	End Zone	Int Zone	End Zone	Int Zone
B	8	8.98	10.23	7.41	8.44	6.21	7.08
	8.67	7.78	8.80	6.42	7.26	5.38	6.09
	9.33	6.83	7.66	5.63	6.32	4.72	5.30
	10	6.04	6.73	4.98	5.55	4.17	4.65
	12	4.38	4.77	3.60	3.93	3.02	3.29
	14	3.33	3.56	2.74	2.93	2.29	2.45
	16	2.63	2.77	2.16	2.27	1.80	1.90
	18	2.14	2.21	1.75	1.81	1.46	1.51
	20	1.77	1.81	1.45	1.48	1.21	1.23
	22	1.50	1.50	1.22	1.23	1.01	1.02
C	8	6.38	7.28	5.08	6.00	4.13	5.03
	8.67	5.53	6.25	4.56	5.15	3.72	4.32
	9.33	4.85	5.44	4.00	4.49	3.35	3.76
	10	4.29	4.78	3.53	3.93	2.95	3.29
	12	3.10	3.38	2.55	2.78	2.13	2.32
	14	2.35	2.52	1.93	2.07	1.61	1.73
	16	1.85	1.95	1.52	1.60	1.26	1.33
	18	1.50	1.55	1.23	1.27	1.02	1.05
	20	1.24	1.26	1.01	1.03	0.84	0.85
	22	1.04	1.05	0.85	0.85	0.70	0.70

Wind Velocity		130		140		150	
Exp	Wall hgt	End Zone	Int Zone	End Zone	Int Zone	End Zone	Int Zone
B	8	5.10	6.02	4.28	5.18	3.64	4.46
	8.67	4.57	5.17	3.85	4.45	3.29	3.87
	9.33	4.01	4.50	3.45	3.87	2.97	3.36
	10	3.54	3.95	3.05	3.39	2.64	2.95
	12	2.56	2.79	2.19	2.40	1.90	2.08
	14	1.94	2.08	1.66	1.78	1.44	1.54
	16	1.53	1.61	1.30	1.37	1.13	1.19
	18	1.23	1.27	1.05	1.09	0.90	0.94
	20	1.02	1.03	0.86	0.88	0.74	0.76
	22	0.85	0.85	0.72	0.72	0.00	0.00
C	8	3.43	4.19	2.90	3.53	2.49	3.02
	8.67	3.10	3.67	2.62	3.15	2.25	2.72
	9.33	2.80	3.19	2.38	2.74	2.04	2.38
	10	2.51	2.79	2.15	2.40	1.85	2.08
	12	1.80	1.97	1.54	1.69	1.33	1.46
	14	1.36	1.46	1.16	1.25	1.00	1.08
	16	1.06	1.12	0.91	0.96	0.78	0.82
	18	0.85	0.89	0.72	0.75	0.00	0.00
	20	0.70	0.71	0.00	0.00	0.00	0.00
	22	0.00	0.00	0.00	0.00	0.00	0.00

**R609.7 Masonry gables.** Gable end walls of concrete or masonry shall be constructed full height to the roof line.

**Exception:** Gable end trusses or wood framed gable end walls in conformance with Tables R609.7A and R609.7B and Figure R609.7. Where masonry gable end walls do not go to the roof a bond beam complying with Section R609.5 shall be provided at the top of the masonry.

**R609.7.1 Rake beam.** Where concrete or masonry is carried full height to the roof line, a cast-in-place rake beam as detailed in Figure R609.7.1 shall be provided. The minimum thickness of the rake beam from top of masonry shall be 4 inches. One No. 5 continuous reinforcing bar shall be placed in the rake beam along the roof line.

**R609.7.2 Vertical reinforcement.** Vertical reinforcement shall be provided at the maximum spacing as set forth in Table R609.7.2A-1 and Table R609.7.2A-2 as applicable.

**R609.7.3 Termination.** Required vertical reinforcement shall terminate at the rake beam in accordance with Section R606.16.7.

**R609.7.4 Nailer.** A minimum 2x4 nailer for connecting roof sheathing shall be bolted to the top of the wall with a minimum of ½" anchor bolts spaced as set forth in Table R609.7.4. The nailer shall be permitted to be bolted to the inside or outside of the wall.

**R609.7.5 Gable Overhang.** Gable overhangs up to 2 feet in width complying with Figure R609.7.5 shall be permitted.


**TABLE R609.7A  
WOOD GABLE BRACE NAILING**

		NAIL SIZE	RAKE HEIGHT					22
			12	14	16	18	20	
<u>EXPOSURE B</u>	<u>100</u>	<u>10d</u>	<u>4</u>	<u>4</u>	<u>5</u>	<u>5</u>	<u>6</u>	<u>6</u>
		<u>8d</u>	<u>6</u>	<u>7</u>	<u>8</u>	<u>8</u>	<u>9</u>	<u>10</u>
	<u>110</u>	<u>10d</u>	<u>4</u>	<u>5</u>	<u>6</u>	<u>6</u>	<u>7</u>	<u>7</u>
		<u>8d</u>	<u>7</u>	<u>8</u>	<u>9</u>	<u>10</u>	<u>11</u>	<u>11</u>
	<u>120</u>	<u>10d</u>	<u>5</u>	<u>6</u>	<u>7</u>	<u>7</u>	<u>8</u>	<u>8</u>
		<u>8d</u>	<u>9</u>	<u>10</u>	<u>11</u>	<u>12</u>	<u>13</u>	<u>13</u>
	<u>130</u>	<u>10d</u>	<u>6</u>	<u>7</u>	<u>8</u>	<u>9</u>	<u>10</u>	<u>10</u>
		<u>8d</u>	<u>10</u>	<u>11</u>	<u>13</u>	<u>14</u>	<u>15</u>	<u>15</u>
	<u>140</u>	<u>10d</u>	<u>7</u>	<u>8</u>	<u>9</u>	<u>10</u>	<u>11</u>	<u>11</u>
		<u>8d</u>	<u>12</u>	<u>13</u>	<u>15</u>	<u>16</u>	<u>18</u>	<u>18</u>
	<u>150</u>	<u>10d</u>	<u>4</u>	<u>4</u>	<u>5</u>	<u>5</u>	<u>6</u>	<u>6</u>
		<u>8d</u>	<u>6</u>	<u>7</u>	<u>8</u>	<u>8</u>	<u>9</u>	<u>9</u>
<u>EXPOSURE C</u>	<u>100</u>	<u>10d</u>	<u>5</u>	<u>6</u>	<u>7</u>	<u>7</u>	<u>8</u>	<u>8</u>
		<u>8d</u>	<u>8</u>	<u>9</u>	<u>11</u>	<u>12</u>	<u>13</u>	<u>13</u>
	<u>110</u>	<u>10d</u>	<u>6</u>	<u>7</u>	<u>8</u>	<u>9</u>	<u>10</u>	<u>10</u>
		<u>8d</u>	<u>10</u>	<u>11</u>	<u>13</u>	<u>14</u>	<u>15</u>	<u>15</u>
	<u>120</u>	<u>10d</u>	<u>7</u>	<u>8</u>	<u>9</u>	<u>10</u>	<u>11</u>	<u>11</u>
		<u>8d</u>	<u>12</u>	<u>14</u>	<u>15</u>	<u>17</u>	<u>18</u>	<u>18</u>
	<u>130</u>	<u>10d</u>	<u>9</u>	<u>10</u>	<u>11</u>	<u>12</u>	<u>13</u>	<u>13</u>
		<u>8d</u>	<u>14</u>	<u>16</u>	<u>18</u>	<u>20</u>	<u>22</u>	<u>22</u>
	<u>140</u>	<u>10d</u>	<u>10</u>	<u>12</u>	<u>13</u>	<u>14</u>	<u>15</u>	<u>15</u>
		<u>8d</u>	<u>16</u>	<u>19</u>	<u>21</u>	<u>23</u>	<u>25</u>	<u>25</u>
	<u>150</u>	<u>10d</u>	<u>12</u>	<u>13</u>	<u>15</u>	<u>16</u>	<u>18</u>	<u>18</u>
		<u>8d</u>	<u>19</u>	<u>21</u>	<u>24</u>	<u>26</u>	<u>29</u>	<u>29</u>

**TABLE R609.7B  
WOOD GABLE STUD CONNECTOR LOADS**

	WIND SPEED	ROOF ZONE	CONNECTOR LOAD		WALL ZONE	
			VERT	HORIZ <sup>1</sup>		
<u>EXPOSURE B</u>	100	2E	43	16	1E	
		2E	43	11	1	
	110	2E	53	20	1E	
		2E	53	13	1	
	120	2E	62	23	1E	
		2E	62	15	1	
	130	2E	73	27	1E	
		2E	73	18	1	
	140	2E	85	32	1E	
		2E	85	21	1	
	150	2E	98	36	1E	
		2E	98	24	1	
	<u>EXPOSURE C</u>	100	2E	61	23	1E
			2E	61	15	1
110		2E	74	28	1E	
		2E	74	18	1	
120		2E	88	33	1E	
		2E	88	22	1	
130		2E	103	38	1E	
		2E	103	25	1	
140		2E	119	45	1E	
		2E	119	30	1	
150		2E	137	51	1E	
		2E	137	34	1	



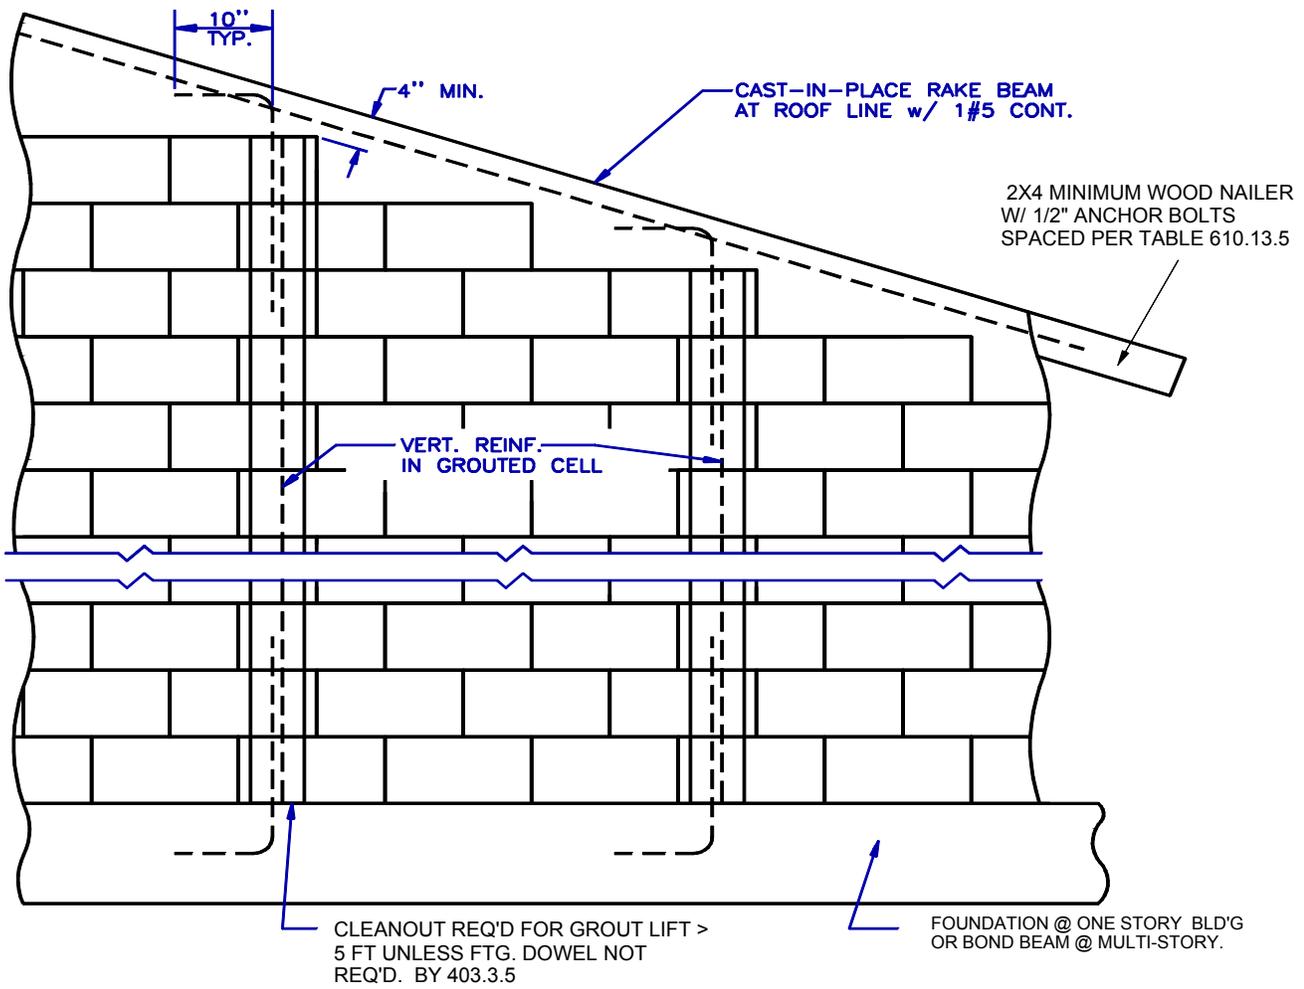

**FIGURE R609.7.1**  
**CONTINUOUS GABLE ENDWALL REINFORCEMENT**  
**ONE AND MULTISTORY**

**TABLE R609.7.2A-1**  
**GRADE 60 MAXIMUM SPACING OF VERTICAL REINFORCEMENT AT CONTINUOUS CONCRETE**  
**MASONRY LOWER STORIES OF MULTISTORY AND GABLE ENDS SINGLE STORY OR**  
**TOP STORY OF MULTISTORY, FEET**

<b>Wind Velocity</b>		<b>100</b>		<b>110</b>		<b>120</b>	
<b>Exp</b>	<b>Wall hgt</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>
<b>B</b>	<u>8</u>	<u>9.87</u>	<u>10.53</u>	<u>8.97</u>	<u>9.57</u>	<u>8.23</u>	<u>8.78</u>
	<u>8.67</u>	<u>9.97</u>	<u>10.59</u>	<u>9.06</u>	<u>9.63</u>	<u>8.30</u>	<u>8.82</u>
	<u>9.33</u>	<u>10.06</u>	<u>10.64</u>	<u>9.14</u>	<u>9.68</u>	<u>8.38</u>	<u>8.87</u>
	<u>10</u>	<u>10.14</u>	<u>10.69</u>	<u>9.22</u>	<u>9.72</u>	<u>8.45</u>	<u>8.91</u>
	<u>12</u>	<u>10.17</u>	<u>10.83</u>	<u>8.38</u>	<u>9.14</u>	<u>7.01</u>	<u>7.65</u>
	<u>14</u>	<u>7.75</u>	<u>8.29</u>	<u>6.37</u>	<u>6.82</u>	<u>5.33</u>	<u>5.70</u>
	<u>16</u>	<u>6.12</u>	<u>6.43</u>	<u>5.03</u>	<u>5.29</u>	<u>4.19</u>	<u>4.41</u>
	<u>18</u>	<u>4.97</u>	<u>5.14</u>	<u>4.07</u>	<u>4.21</u>	<u>3.39</u>	<u>3.51</u>
	<u>20</u>	<u>4.12</u>	<u>4.20</u>	<u>3.38</u>	<u>3.44</u>	<u>2.81</u>	<u>2.86</u>
	<u>22</u>	<u>3.48</u>	<u>3.49</u>	<u>2.84</u>	<u>2.85</u>	<u>2.36</u>	<u>2.36</u>
		-	-	-	-	-	-
<b>C</b>	<u>8</u>	<u>8.34</u>	<u>8.89</u>	<u>7.58</u>	<u>8.09</u>	<u>6.95</u>	<u>7.41</u>
	<u>8.67</u>	<u>8.42</u>	<u>8.94</u>	<u>7.65</u>	<u>8.13</u>	<u>7.01</u>	<u>7.45</u>
	<u>9.33</u>	<u>8.49</u>	<u>8.99</u>	<u>7.72</u>	<u>8.17</u>	<u>7.08</u>	<u>7.49</u>
	<u>10</u>	<u>8.57</u>	<u>9.03</u>	<u>7.79</u>	<u>8.21</u>	<u>6.87</u>	<u>7.53</u>
	<u>12</u>	<u>7.21</u>	<u>7.86</u>	<u>5.92</u>	<u>6.47</u>	<u>4.95</u>	<u>5.40</u>
	<u>14</u>	<u>5.47</u>	<u>5.86</u>	<u>4.49</u>	<u>4.81</u>	<u>3.75</u>	<u>4.01</u>
	<u>16</u>	<u>4.31</u>	<u>4.54</u>	<u>3.53</u>	<u>3.72</u>	<u>2.94</u>	<u>3.09</u>
	<u>18</u>	<u>3.49</u>	<u>3.61</u>	<u>2.85</u>	<u>2.95</u>	<u>2.37</u>	<u>2.45</u>
	<u>20</u>	<u>2.89</u>	<u>2.94</u>	<u>2.35</u>	<u>2.40</u>	<u>1.94</u>	<u>1.98</u>
	<u>22</u>	<u>2.43</u>	<u>2.43</u>	<u>1.97</u>	<u>1.98</u>	<u>1.62</u>	<u>1.63</u>

<b>Wind Velocity</b>		<b>130</b>		<b>140</b>		<b>150</b>	
<b>Exp</b>	<b>Wall hgt</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>
<b>B</b>	<u>8</u>	<u>7.59</u>	<u>8.10</u>	<u>7.05</u>	<u>7.52</u>	<u>6.58</u>	<u>7.02</u>
	<u>8.67</u>	<u>7.67</u>	<u>8.15</u>	<u>7.12</u>	<u>7.56</u>	<u>6.64</u>	<u>7.06</u>
	<u>9.33</u>	<u>7.73</u>	<u>8.19</u>	<u>7.18</u>	<u>7.60</u>	<u>6.70</u>	<u>7.10</u>
	<u>10</u>	<u>7.80</u>	<u>8.23</u>	<u>7.08</u>	<u>7.64</u>	<u>6.14</u>	<u>6.85</u>
	<u>12</u>	<u>5.95</u>	<u>6.49</u>	<u>5.10</u>	<u>5.57</u>	<u>4.42</u>	<u>4.83</u>
	<u>14</u>	<u>4.51</u>	<u>4.83</u>	<u>3.86</u>	<u>4.14</u>	<u>3.34</u>	<u>3.58</u>
	<u>16</u>	<u>3.55</u>	<u>3.73</u>	<u>3.03</u>	<u>3.19</u>	<u>2.62</u>	<u>2.76</u>
	<u>18</u>	<u>2.86</u>	<u>2.96</u>	<u>2.44</u>	<u>2.53</u>	<u>2.10</u>	<u>2.18</u>
	<u>20</u>	<u>2.36</u>	<u>2.41</u>	<u>2.01</u>	<u>2.05</u>	<u>1.72</u>	<u>1.76</u>
	<u>22</u>	<u>1.98</u>	<u>1.99</u>	<u>1.68</u>	<u>1.68</u>	<u>1.43</u>	<u>1.44</u>
		-	-	-	-	-	-
<b>C</b>	<u>8</u>	<u>6.41</u>	<u>6.84</u>	<u>5.95</u>	<u>6.35</u>	<u>5.56</u>	<u>5.93</u>
	<u>8.67</u>	<u>6.47</u>	<u>6.88</u>	<u>6.01</u>	<u>6.39</u>	<u>5.24</u>	<u>5.96</u>
	<u>9.33</u>	<u>6.52</u>	<u>6.91</u>	<u>5.53</u>	<u>6.37</u>	<u>4.75</u>	<u>5.53</u>
	<u>10</u>	<u>5.83</u>	<u>6.50</u>	<u>5.00</u>	<u>5.58</u>	<u>4.31</u>	<u>4.84</u>
	<u>12</u>	<u>4.19</u>	<u>4.58</u>	<u>3.59</u>	<u>3.92</u>	<u>3.10</u>	<u>3.39</u>
	<u>14</u>	<u>3.16</u>	<u>3.39</u>	<u>2.70</u>	<u>2.90</u>	<u>2.33</u>	<u>2.50</u>
	<u>16</u>	<u>2.47</u>	<u>2.61</u>	<u>2.11</u>	<u>2.22</u>	<u>1.81</u>	<u>1.91</u>
	<u>18</u>	<u>1.99</u>	<u>2.06</u>	<u>1.68</u>	<u>1.75</u>	<u>1.44</u>	<u>1.49</u>
	<u>20</u>	<u>1.63</u>	<u>1.66</u>	<u>1.37</u>	<u>1.40</u>	<u>1.16</u>	<u>1.19</u>
	<u>22</u>	<u>1.35</u>	<u>1.35</u>	<u>1.13</u>	<u>1.14</u>	<u>1.03</u>	<u>1.26</u>

**TABLE R609.7.2A-2**


**GRADE 40 MAXIMUM SPACING OF NO. 5 VERTICAL REINFORCEMENT AT CONTINUOUS CONCRETE OR MASONRY LOWER STORIES OF MULTISTORY AND GABLE ENDS SINGLE STORY OR TOP STORY OF MULTISTORY, FEET**

<b>Wind Velocity</b>		<b>100</b>		<b>110</b>		<b>120</b>	
<b>Exp</b>	<b>Wall hgt</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>
<b>B</b>	<u>8</u>	<u>9.87</u>	<u>10.53</u>	<u>8.97</u>	<u>9.57</u>	<u>8.23</u>	<u>8.78</u>
	<u>8.67</u>	<u>9.97</u>	<u>10.59</u>	<u>9.06</u>	<u>9.63</u>	<u>8.30</u>	<u>8.82</u>
	<u>9.33</u>	<u>10.06</u>	<u>10.64</u>	<u>8.73</u>	<u>9.68</u>	<u>7.32</u>	<u>8.21</u>
	<u>10</u>	<u>9.36</u>	<u>10.42</u>	<u>7.72</u>	<u>8.60</u>	<u>6.47</u>	<u>7.20</u>
	<u>12</u>	<u>6.78</u>	<u>7.39</u>	<u>5.58</u>	<u>6.09</u>	<u>4.67</u>	<u>5.10</u>
	<u>14</u>	<u>5.16</u>	<u>5.53</u>	<u>4.25</u>	<u>4.55</u>	<u>3.55</u>	<u>3.80</u>
	<u>16</u>	<u>4.08</u>	<u>4.29</u>	<u>3.35</u>	<u>3.52</u>	<u>2.80</u>	<u>2.94</u>
	<u>18</u>	<u>3.31</u>	<u>3.43</u>	<u>2.72</u>	<u>2.81</u>	<u>2.26</u>	<u>2.34</u>
	<u>20</u>	<u>2.75</u>	<u>2.80</u>	<u>2.25</u>	<u>2.29</u>	<u>1.87</u>	<u>1.90</u>
	<u>22</u>	<u>2.32</u>	<u>2.33</u>	<u>1.90</u>	<u>1.90</u>	<u>1.57</u>	<u>1.58</u>
<b>C</b>	<u>8</u>	<u>8.34</u>	<u>8.89</u>	<u>7.58</u>	<u>8.09</u>	<u>6.40</u>	<u>7.41</u>
	<u>8.67</u>	<u>8.42</u>	<u>8.94</u>	<u>7.06</u>	<u>7.99</u>	<u>5.77</u>	<u>6.69</u>
	<u>9.33</u>	<u>7.52</u>	<u>8.44</u>	<u>6.19</u>	<u>6.95</u>	<u>5.19</u>	<u>5.82</u>
	<u>10</u>	<u>6.65</u>	<u>7.40</u>	<u>5.47</u>	<u>6.10</u>	<u>4.58</u>	<u>5.10</u>
	<u>12</u>	<u>4.80</u>	<u>5.24</u>	<u>3.95</u>	<u>4.31</u>	<u>3.30</u>	<u>3.60</u>
	<u>14</u>	<u>3.65</u>	<u>3.91</u>	<u>3.00</u>	<u>3.21</u>	<u>2.50</u>	<u>2.68</u>
	<u>16</u>	<u>2.88</u>	<u>3.02</u>	<u>2.35</u>	<u>2.48</u>	<u>1.96</u>	<u>2.06</u>
	<u>18</u>	<u>2.33</u>	<u>2.41</u>	<u>1.90</u>	<u>1.97</u>	<u>1.58</u>	<u>1.63</u>
	<u>20</u>	<u>1.92</u>	<u>1.96</u>	<u>1.57</u>	<u>1.60</u>	<u>1.30</u>	<u>1.32</u>
	<u>22</u>	<u>1.62</u>	<u>1.62</u>	<u>1.31</u>	<u>1.32</u>	<u>1.08</u>	<u>1.09</u>

<b>Wind Velocity</b>		<b>130</b>		<b>140</b>		<b>150</b>	
<b>Exp</b>	<b>Wall hgt</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>	<b>End Zone</b>	<b>Int Zone</b>
<b>B</b>	<u>8</u>	<u>7.59</u>	<u>8.10</u>	<u>6.63</u>	<u>7.52</u>	<u>5.65</u>	<u>6.91</u>
	<u>8.67</u>	<u>7.09</u>	<u>8.02</u>	<u>5.97</u>	<u>6.90</u>	<u>5.09</u>	<u>5.99</u>
	<u>9.33</u>	<u>6.22</u>	<u>6.98</u>	<u>5.35</u>	<u>6.00</u>	<u>4.61</u>	<u>5.21</u>
	<u>10</u>	<u>5.49</u>	<u>6.12</u>	<u>4.72</u>	<u>5.26</u>	<u>4.10</u>	<u>4.57</u>
	<u>12</u>	<u>3.96</u>	<u>4.33</u>	<u>3.40</u>	<u>3.71</u>	<u>2.95</u>	<u>3.22</u>
	<u>14</u>	<u>3.01</u>	<u>3.22</u>	<u>2.58</u>	<u>2.76</u>	<u>2.23</u>	<u>2.39</u>
	<u>16</u>	<u>2.36</u>	<u>2.49</u>	<u>2.02</u>	<u>2.13</u>	<u>1.74</u>	<u>1.84</u>
	<u>18</u>	<u>1.91</u>	<u>1.98</u>	<u>1.63</u>	<u>1.69</u>	<u>1.40</u>	<u>1.45</u>
	<u>20</u>	<u>1.57</u>	<u>1.60</u>	<u>1.34</u>	<u>1.36</u>	<u>1.15</u>	<u>1.17</u>
	<u>22</u>	<u>1.32</u>	<u>1.32</u>	<u>1.12</u>	<u>1.12</u>	<u>0.00</u>	<u>0.00</u>
<b>C</b>	<u>8</u>	<u>5.32</u>	<u>6.50</u>	<u>4.50</u>	<u>5.47</u>	<u>3.86</u>	<u>4.68</u>
	<u>8.67</u>	<u>4.80</u>	<u>5.69</u>	<u>4.07</u>	<u>4.89</u>	<u>3.49</u>	<u>4.22</u>
	<u>9.33</u>	<u>4.35</u>	<u>4.95</u>	<u>3.69</u>	<u>4.25</u>	<u>3.17</u>	<u>3.68</u>
	<u>10</u>	<u>3.88</u>	<u>4.33</u>	<u>3.33</u>	<u>3.72</u>	<u>2.87</u>	<u>3.22</u>
	<u>12</u>	<u>2.79</u>	<u>3.05</u>	<u>2.39</u>	<u>2.61</u>	<u>2.07</u>	<u>2.26</u>
	<u>14</u>	<u>2.11</u>	<u>2.26</u>	<u>1.80</u>	<u>1.93</u>	<u>1.55</u>	<u>1.67</u>
	<u>16</u>	<u>1.65</u>	<u>1.74</u>	<u>1.40</u>	<u>1.48</u>	<u>1.21</u>	<u>1.27</u>
	<u>18</u>	<u>1.32</u>	<u>1.37</u>	<u>1.12</u>	<u>1.16</u>	<u>0.00</u>	<u>0.00</u>
	<u>20</u>	<u>1.08</u>	<u>1.10</u>	<u>0.00</u>	<u>0.00</u>	<u>0.00</u>	<u>0.00</u>
	<u>22</u>	<u>0.00</u>	<u>0.00</u>	<u>0.00</u>	<u>0.00</u>	<u>0.00</u>	<u>0.00</u>

**TABLE R609.7.4**  
**ANCHOR BOLT SPACING FOR ATTACHING**  
**2X4 MINIMUM WOOD NAILER TO RAKE BEAM**

<u>REQUIRED ROOF DIAPHRAGM CAPACITY</u>	<u>1/2-INCH ANCHOR BOLT MAXIMUM SPACING</u>
$\leq 105$	6'-0"
145	5'-0"
195	4'-0"
230	3'-6"
270	3'-0"
325	2'-6"
415	2'-0"
565	1'-6"
700	1'-2"
845	1'-0"

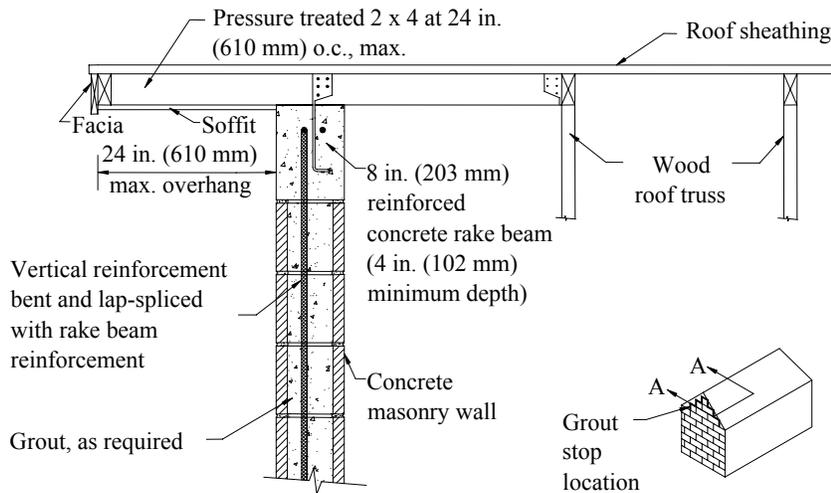

**FIGURE R609.7.5**  
**GABLE OVERHANG**

**R609.8 Exterior shearwalls.** Each exterior wall shall have the required length of effective shearwall to resist horizontal movement or forces at the ends of diaphragms in conformance with this section.

**R09.8.1 Shearwall lengths.** The required shearwall segment length shall be as set forth in Table R609.8.1A through Table R609.8.1L as applicable.

**R6609.8.2 Multi-story shearwalls.** Shearwall segments in an upper story shall be located directly over and within the length of shearwall segments in the story below. Reinforcement at the ends of shearwall segments shall be continuous from the bond beam of the upper story through the story below.

**Exception:** Offsetting of vertical reinforcement as set forth in Section R606.16.8.1 shall be permitted.

**R609.8.3** The connector load for total shear at the top story wall shall be determined in accordance with Table R609.8.3A and Figure R609.8.3. Transverse connector loads shall be in accordance with Table R 609.8.3B and Figure R609.8.3

**R609.8.4** Endwall roof shear loads shall be in accordance with Table R609.8.4.

**TABLE R609.8.1-A GRADE 60  
REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE No. 4 REINFORCEMENT**

		ROOF ANGLE $\leq 23^{\circ}$								
		TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
Exposure	Wind Speed	BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.96	1.37	1.87	2.19	2.96	3.86	3.22	4.33	5.61
	110	1.16	1.66	2.26	2.65	3.59	4.67	3.90	5.24	6.79
	120	1.39	1.98	2.69	3.16	4.27	5.56	4.64	6.24	8.08
	130	1.63	2.32	3.16	3.70	5.01	6.52	5.44	7.32	9.49
	140	1.89	2.69	3.66	4.29	5.81	7.57	6.31	8.49	11.00
	150	2.17	3.09	4.21	4.93	6.67	8.68	7.24	9.75	12.63
C	100	1.14	1.65	2.27	2.89	3.94	5.17	4.50	6.04	7.81
	110	1.38	1.99	2.75	3.50	4.77	6.26	5.44	7.31	9.45
	120	1.64	2.37	3.27	4.17	5.68	7.45	6.48	8.69	11.25
	130	1.93	2.78	3.84	4.89	6.66	8.74	7.60	10.20	13.20
	140	2.24	3.23	4.46	5.67	7.73	10.14	8.81	11.83	15.31
	150	2.57	3.71	5.12	6.51	8.87	11.64	10.12	13.59	17.57

**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE  
No. 5 REINFORCEMENT**

		ROOF ANGLE $\leq 23^{\circ}$								
		TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
Exposure	Wind Speed	BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.77	1.10	1.49	1.75	2.37	3.08	2.57	3.46	4.48
	110	0.93	1.33	1.81	2.12	2.86	3.73	3.11	4.19	5.43
	120	1.11	1.58	2.15	2.52	3.41	4.44	3.70	4.98	6.46
	130	1.30	1.85	2.52	2.96	4.00	5.21	4.35	5.85	7.58
	140	1.51	2.15	2.93	3.43	4.64	6.04	5.04	6.78	8.79
	150	1.73	2.47	3.36	3.94	5.33	6.94	5.79	7.78	10.09
C	100	0.91	1.32	1.82	2.31	3.15	4.13	3.59	4.82	6.24
	110	1.10	1.59	2.20	2.80	3.81	5.00	4.35	5.84	7.55
	120	1.31	1.90	2.61	3.33	4.54	5.95	5.17	6.94	8.98
	130	1.54	2.22	3.07	3.90	5.32	6.98	6.07	8.15	10.54
	140	1.79	2.58	3.56	4.53	6.17	8.10	7.04	9.45	12.23
	150	2.05	2.96	4.09	5.20	7.09	9.30	8.08	10.85	14.04

**TABLE R609.8.1-B GRADE 60  
REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE  
No. 4 REINFORCEMENT  
ROOF ANGLE 30<sup>0</sup>**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.99	1.46	2.02	2.11	2.93	3.86	3.08	4.24	5.57
	110	1.20	1.76	2.45	2.56	3.55	4.68	3.73	5.14	6.74
	120	1.42	2.10	2.91	3.04	4.22	5.56	4.44	6.11	8.02
	130	1.67	2.46	3.42	3.57	4.95	6.53	5.21	7.17	9.41
	140	1.94	2.85	3.96	4.14	5.74	7.57	6.04	8.32	10.91
	150	2.22	3.28	4.55	4.76	6.59	8.69	6.94	9.55	12.53
C	100	1.19	1.78	2.51	2.81	3.94	5.25	4.30	5.90	7.72
	110	1.44	2.15	3.03	3.41	4.77	6.35	5.20	7.14	9.34
	120	1.71	2.56	3.61	4.05	5.67	7.56	6.19	8.50	11.12
	130	2.01	3.01	4.24	4.76	6.66	8.87	7.26	9.97	13.05
	140	2.33	3.49	4.91	5.52	7.72	10.28	8.42	11.57	15.13
	150	2.67	4.00	5.64	6.33	8.87	11.81	9.67	13.28	17.37

**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE  
No. 5 REINFORCEMENT  
ROOF ANGLE 30<sup>0</sup>**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.79	1.16	1.61	1.69	2.34	3.09	2.46	3.39	4.45
	110	0.96	1.41	1.95	2.04	2.83	3.73	2.98	4.10	5.38
	120	1.14	1.67	2.32	2.43	3.37	4.44	3.55	4.88	6.40
	130	1.33	1.97	2.73	2.85	3.95	5.22	4.16	5.73	7.52
	140	1.55	2.28	3.16	3.31	4.59	6.05	4.83	6.64	8.72
	150	1.78	2.62	3.63	3.80	5.26	6.94	5.54	7.63	10.01
C	100	0.95	1.42	2.00	2.25	3.15	4.19	3.43	4.71	6.17
	110	1.15	1.72	2.42	2.72	3.81	5.07	4.15	5.70	7.46
	120	1.37	2.05	2.88	3.24	4.53	6.03	4.94	6.79	8.88
	130	1.60	2.40	3.38	3.80	5.32	7.08	5.80	7.96	10.42
	140	1.86	2.78	3.93	4.41	6.17	8.21	6.73	9.24	12.09
	150	2.14	3.20	4.51	5.06	7.08	9.43	7.72	10.60	13.87

**TABLE R609.8.1-C GRADE 60**  
**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE**  
**No. 4 REINFORCEMENT**  
**ROOF ANGLE 45°**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	1.26	1.93	2.76	1.26	3.40	4.60	3.43	4.86	6.55
	110	1.52	2.33	3.34	2.89	4.12	5.57	4.15	5.89	7.92
	120	1.81	2.78	3.97	3.43	4.90	6.63	4.94	7.00	9.43
	130	2.13	3.26	4.66	4.03	5.75	7.78	5.80	8.22	11.07
	140	2.47	3.78	5.41	4.67	6.67	9.02	6.73	9.53	12.84
	150	2.83	4.34	6.21	5.36	7.65	10.35	7.72	10.94	14.73
C	100	1.57	2.46	3.59	3.24	4.70	6.45	4.30	5.90	7.72
	110	1.89	2.97	4.34	3.92	5.69	7.81	5.20	7.14	9.34
	120	2.25	3.54	5.17	4.67	6.77	9.29	6.19	8.50	11.12
	130	2.65	4.15	6.07	5.48	7.94	10.90	7.26	9.97	13.05
	140	3.07	4.81	7.03	6.36	9.21	12.65	8.42	11.57	15.13
	150	3.52	5.52	8.08	7.30	10.58	14.52	9.67	13.28	17.37

**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE**  
**No. 5 REINFORCEMENT**  
**ROOF ANGLE 45°**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	1.01	1.54	2.20	1.90	2.72	3.68	2.74	3.88	5.23
	110	1.22	1.86	2.67	2.30	3.29	4.45	3.32	4.70	6.33
	120	1.45	2.22	3.17	2.74	3.91	5.29	3.95	5.59	7.53
	130	1.70	2.60	3.72	3.22	4.59	6.21	4.63	6.57	8.84
	140	1.97	3.02	4.32	3.73	5.33	7.20	5.37	7.61	10.25
	150	2.26	3.46	4.96	4.28	6.11	8.27	6.17	8.74	11.77
C	100	1.25	1.96	2.87	2.59	3.75	5.15	3.80	5.36	7.19
	110	1.51	2.37	3.47	3.13	4.54	6.24	4.60	6.49	8.70
	120	1.80	2.82	4.13	3.73	5.41	7.42	5.47	7.72	10.35
	130	2.11	3.31	4.84	4.38	6.35	8.71	6.42	9.06	12.15
	140	2.45	3.84	5.62	5.08	7.36	10.10	7.45	10.51	14.09
	150	2.81	4.41	6.45	5.83	8.45	11.59	8.55	12.06	16.18

**TABLE R609.8.1-D GRADE 60  
REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 4 REINFORCEMENT  
PER FOOT OF BUILDING LENGTH  
ROOF ANGLE  $\leq 23^{\circ}$**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.032	0.032	0.031	0.085	0.084	0.084	0.137	0.137	0.137
	110	0.039	0.038	0.038	0.102	0.102	0.102	0.166	0.166	0.166
	120	0.046	0.046	0.045	0.122	0.122	0.121	0.198	0.198	0.197
	130	0.054	0.054	0.053	0.143	0.143	0.142	0.232	0.232	0.231
	140	0.063	0.062	0.061	0.166	0.166	0.165	0.269	0.269	0.268
	150	0.072	0.071	0.071	0.191	0.190	0.189	0.309	0.309	0.308
C	100	0.045	0.044	0.044	0.119	0.118	0.118	0.193	0.192	0.192
	110	0.054	0.054	0.053	0.144	0.143	0.143	0.233	0.233	0.232
	120	0.064	0.064	0.063	0.171	0.171	0.170	0.277	0.277	0.276
	130	0.076	0.075	0.074	0.201	0.200	0.199	0.326	0.325	0.324
	140	0.088	0.087	0.086	0.233	0.232	0.231	0.378	0.377	0.376
	150	0.101	0.100	0.099	0.267	0.267	0.265	0.434	0.433	0.432

**REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 5 REINFORCEMENT  
PER FOOT OF BUILDING LENGTH**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.025	0.025	0.025	0.068	0.067	0.067	0.110	0.110	0.109
	110	0.031	0.031	0.030	0.082	0.082	0.081	0.133	0.133	0.132
	120	0.037	0.036	0.036	0.097	0.097	0.097	0.158	0.158	0.157
	130	0.043	0.043	0.042	0.114	0.114	0.114	0.186	0.185	0.185
	140	0.050	0.050	0.049	0.133	0.132	0.132	0.215	0.215	0.214
	150	0.057	0.057	0.056	0.152	0.152	0.151	0.247	0.247	0.246
C	100	0.036	0.036	0.035	0.095	0.095	0.094	0.154	0.154	0.153
	110	0.043	0.043	0.042	0.115	0.114	0.114	0.186	0.186	0.185
	120	0.051	0.051	0.051	0.137	0.136	0.136	0.222	0.221	0.221
	130	0.060	0.060	0.059	0.160	0.160	0.159	0.260	0.260	0.259
	140	0.070	0.070	0.069	0.186	0.185	0.185	0.302	0.301	0.300
	150	0.080	0.080	0.079	0.213	0.213	0.212	0.346	0.346	0.345

**TABLE R609.8.1-E GRADE 60  
REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 4 REINFORCEMENT  
PER FOOT OF BUILDING LENGTH  
ROOF ANGLE 30<sup>0</sup>**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.053	0.061	0.070	0.099	0.107	0.116	0.145	0.153	0.162
	110	0.064	0.074	0.084	0.119	0.129	0.140	0.175	0.185	0.196
	120	0.076	0.088	0.100	0.142	0.154	0.167	0.209	0.221	0.233
	130	0.089	0.103	0.118	0.167	0.181	0.196	0.245	0.259	0.274
	140	0.103	0.119	0.137	0.193	0.210	0.227	0.284	0.300	0.318
	150	0.118	0.137	0.157	0.222	0.241	0.261	0.326	0.345	0.365
C	100	0.074	0.085	0.098	0.138	0.150	0.162	0.203	0.215	0.227
	110	0.089	0.103	0.118	0.167	0.181	0.197	0.246	0.260	0.275
	120	0.106	0.123	0.141	0.199	0.216	0.234	0.292	0.309	0.327
	130	0.124	0.144	0.165	0.234	0.253	0.275	0.343	0.363	0.384
	140	0.144	0.167	0.192	0.271	0.294	0.318	0.398	0.421	0.445
	150	0.166	0.192	0.220	0.311	0.337	0.366	0.457	0.483	0.511

**REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 5 REINFORCEMENT  
PER FOOT OF BUILDING LENGTH  
ROOF ANGLE 30<sup>0</sup>**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
	100	0.042	0.049	0.056	0.079	0.085	0.093	0.116	0.122	0.129
	110	0.051	0.059	0.067	0.095	0.103	0.112	0.140	0.148	0.157
	120	0.060	0.070	0.080	0.113	0.123	0.133	0.167	0.176	0.186
	130	0.071	0.082	0.094	0.133	0.144	0.156	0.195	0.207	0.219
	140	0.082	0.095	0.109	0.154	0.167	0.181	0.227	0.240	0.254
	150	0.094	0.109	0.125	0.177	0.192	0.208	0.260	0.275	0.291
C	100	0.059	0.068	0.078	0.110	0.120	0.130	0.162	0.171	0.181
	110	0.071	0.082	0.094	0.134	0.145	0.157	0.196	0.207	0.220
	120	0.085	0.098	0.112	0.159	0.172	0.187	0.234	0.247	0.261
	130	0.099	0.115	0.132	0.187	0.202	0.219	0.274	0.290	0.307
	140	0.115	0.133	0.153	0.217	0.235	0.254	0.318	0.336	0.356
	150	0.132	0.153	0.176	0.249	0.270	0.292	0.365	0.386	0.408

**TABLE R609.8.1-F GRADE 60  
REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE  
No. 4 REINFORCEMENT PER FOOT OF BUILDING LENGTH  
ROOF ANGLE 45°**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.070	0.085	0.100	0.116	0.131	0.146	0.163	0.177	0.192
	110	0.085	0.102	0.121	0.141	0.158	0.177	0.197	0.214	0.233
	120	0.101	0.122	0.144	0.168	0.188	0.211	0.234	0.255	0.277
	130	0.119	0.143	0.169	0.197	0.221	0.247	0.275	0.299	0.325
	140	0.138	0.166	0.196	0.228	0.256	0.287	0.319	0.347	0.377
	150	0.158	0.191	0.225	0.262	0.294	0.329	0.366	0.398	0.433
C	100	0.099	0.119	0.140	0.163	0.183	0.205	0.228	0.248	0.270
	110	0.119	0.144	0.170	0.198	0.222	0.248	0.276	0.300	0.326
	120	0.142	0.171	0.202	0.235	0.264	0.295	0.328	0.357	0.388
	130	0.167	0.201	0.237	0.276	0.310	0.347	0.385	0.419	0.456
	140	0.193	0.233	0.275	0.320	0.360	0.402	0.447	0.486	0.529
	150	0.222	0.267	0.316	0.367	0.413	0.461	0.513	0.558	0.607

**REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 5 REINFORCEMENT PER FOOT OF  
BUILDING LENGTH  
ROOF ANGLE 45°**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.056	0.068	0.080	0.093	0.105	0.117	0.130	0.141	0.154
	110	0.068	0.082	0.097	0.113	0.126	0.141	0.157	0.171	0.186
	120	0.081	0.097	0.115	0.134	0.150	0.168	0.187	0.204	0.221
	130	0.095	0.114	0.135	0.157	0.177	0.197	0.219	0.239	0.260
	140	0.110	0.133	0.157	0.182	0.205	0.229	0.255	0.277	0.301
	150	0.126	0.152	0.180	0.209	0.235	0.263	0.292	0.318	0.346
C	100	0.079	0.095	0.112	0.130	0.147	0.164	0.182	0.198	0.215
	110	0.095	0.115	0.136	0.158	0.177	0.198	0.220	0.240	0.261
	120	0.113	0.137	0.161	0.188	0.211	0.236	0.262	0.285	0.310
	130	0.133	0.160	0.189	0.220	0.248	0.277	0.308	0.335	0.364
	140	0.154	0.186	0.220	0.256	0.287	0.321	0.357	0.388	0.422
	150	0.177	0.213	0.252	0.293	0.330	0.369	0.410	0.446	0.485

Notes for Tables 609.8.1A - F:

1. The cumulative shear wall segment length for each side of the building shall be equal to or greater than the tabular shear wall length required. If the required shear wall segment length provided is not continuous the total shear wall length required shall be increased by 8" for each additional shear wall segment on a side.
2. Minimum shear wall segment length shall be 2'-0". A minimum length of 24 inches (610 mm) of solid wall segment, extending the full height of each wall story, shall be provided at all interior and exterior corners of exterior walls. A filled cell with reinforcing steel shall be provided at each end of every shear wall segment.
3. Portions of walls with openings shall not be considered part of the shear wall length.
4. Required shearwall lengths parallel to the ridge are per lineal foot of building length. Multiply tabular values by building length for total shear load.

**TABLE 609.8.1-G GRADE 40  
REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 4 REINFORCEMENT<sup>1,2,3,5</sup>**

		ROOF ANGLE $\leq 23^{\circ}$								
		TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
Exposure	Wind Speed	BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	1.42	2.02	2.75	3.23	4.37	5.69	4.74	6.38	8.27
	110	1.72	2.44	3.33	3.90	5.28	6.88	5.74	7.72	10.01
	120	2.04	2.91	3.97	4.65	6.29	8.19	6.83	9.19	11.91
	130	2.40	3.41	4.65	5.45	7.38	9.61	8.01	10.78	13.97
	140	2.78	3.96	5.40	6.33	8.56	11.14	9.29	12.50	16.21
	150	3.19	4.55	6.20	7.26	9.82	12.79	10.67	14.35	18.61
C	100	1.68	2.43	3.35	4.26	5.81	7.62	6.62	8.89	11.50
	110	2.03	2.94	4.05	5.16	7.03	9.22	8.01	10.76	13.92
	120	2.42	3.49	4.82	6.14	8.36	10.97	9.54	12.81	16.57
	130	2.84	4.10	5.66	7.20	9.82	12.88	11.19	15.03	19.44
	140	3.30	4.76	6.56	8.35	11.38	14.94	12.98	17.43	22.55
	150	3.78	5.46	7.53	9.59	13.07	17.15	14.90	20.01	25.89

**REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 5 REINFORCEMENT<sup>1,2,3,6</sup>**

		ROOF ANGLE $\leq 23^{\circ}$								
		TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
Exposure	Wind Speed	BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	1.14	1.62	2.21	2.59	3.50	4.56	3.80	5.12	6.63
	110	1.38	1.96	2.67	3.13	4.24	5.52	4.60	6.19	8.02
	120	1.64	2.33	3.18	3.73	5.04	6.57	5.48	7.37	9.55
	130	1.92	2.74	3.73	4.37	5.92	7.71	6.43	8.65	11.21
	140	2.23	3.18	4.33	5.07	6.86	8.94	7.45	10.03	13.00
	150	2.56	3.65	4.97	5.82	7.88	10.26	8.56	11.51	14.92
C	100	1.35	1.95	2.69	3.42	4.66	6.11	5.31	7.13	9.23
	110	1.63	2.36	3.25	4.13	5.64	7.40	6.43	8.63	11.16
	120	1.94	2.80	3.87	4.92	6.71	8.80	7.65	10.27	13.29
	130	2.28	3.29	4.54	5.77	7.87	10.33	8.98	12.05	15.59
	140	2.64	3.82	5.26	6.70	9.13	11.98	10.41	13.98	18.08
	150	3.03	4.38	6.04	7.69	10.48	13.75	11.95	16.05	20.76

**TABLE 609.8.1-H GRADE 40  
REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 4 REINFORCEMENT<sup>1,2,3,5</sup>**

		ROOF ANGLE 30°								
		TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3			1ST STORY OF 3 STORY		
Exposure	Wind Speed	BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	1.46	2.14	2.98	3.11	4.32	5.69	4.54	6.25	8.20
	110	1.76	2.59	3.60	3.77	5.22	6.89	5.50	7.57	9.92
	120	2.10	3.09	4.29	4.48	6.21	8.19	6.54	9.00	11.81
	130	2.46	3.62	5.03	5.26	7.29	9.62	7.67	10.57	13.86
	140	2.85	4.20	5.84	6.10	8.46	11.15	8.90	12.25	16.07
	150	3.28	4.82	6.70	7.01	9.71	12.80	10.22	14.07	18.45
C	100	1.75	2.62	3.69	4.15	5.80	7.73	6.33	8.69	11.37
	110	2.12	3.17	4.47	5.02	7.02	9.35	7.66	10.52	13.76
	120	2.52	3.77	5.32	5.97	8.36	11.13	9.11	12.51	16.37
	130	2.96	4.43	6.24	7.01	9.81	13.06	10.70	14.69	19.22
	140	3.43	5.14	7.24	8.12	11.37	15.15	12.41	17.03	22.29
	150	3.94	5.90	8.31	9.33	13.06	17.39	14.24	19.55	25.58

**REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 5 REINFORCEMENT<sup>1,2,3,6</sup>**

		ROOF ANGLE 30°								
		TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3			1ST STORY OF 3 STORY		
Exposure	Wind Speed	BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	1.17	1.72	2.39	2.50	3.46	4.56	3.64	5.01	6.58
	110	1.41	2.08	2.89	3.02	4.19	5.52	4.41	6.07	7.96
	120	1.68	2.48	3.44	3.60	4.98	6.57	5.24	7.22	9.47
	130	1.97	2.91	4.04	4.22	5.85	7.71	6.15	8.47	11.11
	140	2.29	3.37	4.68	4.89	6.78	8.95	7.14	9.83	12.89
	150	2.63	3.87	5.37	5.62	7.79	10.27	8.19	11.28	14.80
C	100	1.40	2.10	2.96	3.32	4.65	6.20	5.08	6.97	9.12
	110	1.70	2.54	3.58	4.02	5.63	7.50	6.14	8.43	11.03
	120	2.02	3.03	4.27	4.79	6.70	8.92	7.31	10.04	13.13
	130	2.37	3.55	5.01	5.62	7.87	10.47	8.58	11.78	15.41
	140	2.75	4.12	5.81	6.52	9.12	12.15	9.95	13.66	17.87
	150	3.16	4.73	6.66	7.48	10.47	13.94	11.42	15.68	20.52

**TABLE 609.8.1-I GRADE 40  
REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 4 REINFORCEMENT<sup>1,2,3,5</sup>**

		<b>ROOF ANGLE 45°</b>								
		<b>TOP STORY</b>			<b>1ST STORY OF 2 STORY OR 2ND STORY OF 3</b>			<b>1ST STORY OF 3 STORY</b>		
<b>Exposure</b>	<b>Wind Speed</b>	<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>		
		24	32	40	24	32	40	24	32	40
<b>B</b>	100	1.85	2.84	4.06	1.85	5.01	6.78	5.06	7.16	9.65
	110	2.24	3.44	4.92	4.25	6.06	8.20	6.12	8.67	11.67
	120	2.67	4.09	5.85	5.06	7.22	9.76	7.28	10.32	13.89
	130	3.13	4.80	6.87	5.93	8.47	11.45	8.54	12.11	16.30
	140	3.63	5.57	7.97	6.88	9.82	13.28	9.91	14.04	18.90
	150	4.17	6.39	9.14	7.90	11.27	15.25	11.38	16.12	21.70
<b>C</b>	100	2.31	3.62	5.29	4.78	6.92	9.50	6.33	8.69	11.37
	110	2.79	4.38	6.40	5.78	8.38	11.50	7.66	10.52	13.76
	120	3.32	5.21	7.61	6.88	9.97	13.68	9.11	12.51	16.37
	130	3.90	6.11	8.93	8.07	11.70	16.06	10.70	14.69	19.22
	140	4.52	7.09	10.36	9.36	13.57	18.63	12.41	17.03	22.29
	150	5.19	8.14	11.89	10.75	15.58	21.38	14.24	19.55	25.58

**REQUIRED SHEARWALL LENGTH PARALLEL TO RIDGE No. 5 REINFORCEMENT<sup>1,2,3,6</sup>**

		<b>ROOF ANGLE 45°</b>								
		<b>TOP STORY</b>			<b>1ST STORY OF 2 STORY OR 2ND STORY OF 3</b>			<b>1ST STORY OF 3 STORY</b>		
<b>Exposure</b>	<b>Wind Speed</b>	<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>		
		24	32	40	24	32	40	24	32	40
<b>B</b>	100	1.49	2.28	3.26	2.82	4.02	5.44	4.05	5.75	7.74
	110	1.80	2.76	3.94	3.41	4.86	6.58	4.91	6.95	9.36
	120	2.14	3.28	4.69	4.06	5.79	7.83	5.84	8.27	11.14
	130	2.51	3.85	5.51	4.76	6.79	9.19	6.85	9.71	13.07
	140	2.91	4.46	6.39	5.52	7.88	10.65	7.95	11.26	15.16
	150	3.35	5.12	7.33	6.34	9.04	12.23	9.12	12.93	17.40
<b>C</b>	100	1.85	2.90	4.24	3.83	5.55	7.62	5.62	7.93	10.63
	110	2.24	3.51	5.13	4.64	6.72	9.22	6.80	9.59	12.87
	120	2.66	4.18	6.10	5.52	8.00	10.97	8.09	11.42	15.31
	130	3.13	4.90	7.16	6.48	9.38	12.88	9.50	13.40	17.97
	140	3.62	5.68	8.31	7.51	10.88	14.94	11.01	15.54	20.84
	150	4.16	6.53	9.54	8.62	12.49	17.15	12.64	17.84	23.92

**TABLE 609.8.1-J GRADE 40**  
**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE No. 4 REINFORCEMENT PER FOOT OF**  
**BUILDING LENGTH<sup>1,2,3,4,5</sup>**  
**ROOF ANGLE  $\leq 23^{\circ}$**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.047	0.047	0.046	0.125	0.124	0.124	0.202	0.202	0.202
	110	0.057	0.057	0.056	0.151	0.151	0.150	0.245	0.245	0.244
	120	0.068	0.067	0.067	0.180	0.179	0.178	0.291	0.291	0.290
	130	0.079	0.079	0.078	0.211	0.210	0.209	0.342	0.342	0.341
	140	0.092	0.092	0.091	0.244	0.244	0.243	0.397	0.396	0.395
	150	0.106	0.105	0.104	0.281	0.280	0.279	0.455	0.455	0.454
C	100	0.066	0.066	0.065	0.175	0.174	0.174	0.284	0.283	0.283
	110	0.080	0.079	0.078	0.212	0.211	0.210	0.343	0.343	0.342
	120	0.095	0.094	0.093	0.252	0.251	0.250	0.409	0.408	0.407
	130	0.111	0.111	0.109	0.295	0.295	0.294	0.480	0.479	0.478
	140	0.129	0.128	0.127	0.343	0.342	0.340	0.556	0.556	0.554
	150	0.148	0.147	0.146	0.393	0.393	0.391	0.639	0.638	0.636

**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE No. 5 REINFORCEMENT PER FOOT OF**  
**BUILDING LENGTH<sup>1,2,3,4,6</sup>**  
**ROOF ANGLE  $\leq 23^{\circ}$**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.038	0.037	0.037	0.100	0.100	0.099	0.162	0.162	0.162
	110	0.046	0.045	0.045	0.121	0.121	0.120	0.196	0.196	0.196
	120	0.054	0.054	0.053	0.144	0.144	0.143	0.234	0.233	0.233
	130	0.064	0.063	0.063	0.169	0.169	0.168	0.274	0.274	0.273
	140	0.074	0.073	0.073	0.196	0.196	0.195	0.318	0.318	0.317
	150	0.085	0.084	0.083	0.225	0.225	0.224	0.365	0.365	0.364
C	100	0.053	0.053	0.052	0.140	0.140	0.139	0.228	0.227	0.227
	110	0.064	0.064	0.063	0.170	0.169	0.169	0.275	0.275	0.274
	120	0.076	0.076	0.075	0.202	0.201	0.201	0.328	0.327	0.326
	130	0.089	0.089	0.088	0.237	0.236	0.235	0.385	0.384	0.383
	140	0.104	0.103	0.102	0.275	0.274	0.273	0.446	0.446	0.444
	150	0.119	0.118	0.117	0.316	0.315	0.313	0.512	0.511	0.510

**TABLE 609.8.1-J GRADE 40**  
**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE No. 4 REINFORCEMENT PER FOOT OF**  
**BUILDING LENGTH<sup>1,2,3,4,5</sup>**

**ROOF ANGLE 30°**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.077	0.090	0.103	0.145	0.158	0.171	0.213	0.226	0.239
	110	0.094	0.108	0.124	0.176	0.191	0.207	0.258	0.273	0.289
	120	0.111	0.129	0.148	0.209	0.227	0.246	0.307	0.325	0.344
	130	0.131	0.151	0.174	0.246	0.266	0.288	0.360	0.381	0.403
	140	0.152	0.176	0.201	0.285	0.309	0.335	0.418	0.442	0.468
	150	0.174	0.202	0.231	0.327	0.354	0.384	0.480	0.507	0.537
C	100	0.108	0.126	0.144	0.204	0.221	0.239	0.299	0.316	0.335
	110	0.131	0.152	0.174	0.247	0.267	0.290	0.362	0.383	0.405
	120	0.156	0.181	0.207	0.293	0.318	0.345	0.431	0.455	0.482
	130	0.183	0.212	0.243	0.344	0.373	0.404	0.505	0.534	0.565
	140	0.213	0.246	0.282	0.399	0.433	0.469	0.586	0.620	0.656
	150	0.244	0.283	0.324	0.458	0.497	0.538	0.673	0.711	0.753

**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE No. 5 REINFORCEMENT PER FOOT OF**  
**BUILDING LENGTH<sup>1,2,3,4,6</sup>**

**ROOF ANGLE 30°**

Exposure	Wind Speed	TOP STORY			1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY			1ST STORY OF 3 STORY		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	0.062	0.072	0.082	0.117	0.126	0.137	0.171	0.181	0.191
	110	0.075	0.087	0.100	0.141	0.153	0.166	0.207	0.219	0.232
	120	0.089	0.103	0.119	0.168	0.182	0.197	0.246	0.260	0.276
	130	0.105	0.121	0.139	0.197	0.214	0.231	0.289	0.306	0.323
	140	0.122	0.141	0.161	0.228	0.248	0.268	0.335	0.355	0.375
	150	0.140	0.162	0.185	0.262	0.284	0.308	0.385	0.407	0.431
C	100	0.087	0.101	0.115	0.163	0.177	0.192	0.240	0.254	0.268
	110	0.105	0.122	0.140	0.198	0.214	0.232	0.290	0.307	0.325
	120	0.125	0.145	0.166	0.235	0.255	0.276	0.345	0.365	0.386
	130	0.147	0.170	0.195	0.276	0.299	0.324	0.405	0.429	0.453
	140	0.170	0.197	0.226	0.320	0.347	0.376	0.470	0.497	0.526
	150	0.196	0.227	0.260	0.368	0.399	0.432	0.540	0.571	0.604

**TABLE 609.8.1-K GRADE 40**  
**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE No. 4 REINFORCEMENT PER FOOT OF**  
**BUILDING LENGTH<sup>1,2,3,4,5</sup>**

		<b>ROOF ANGLE 45°</b>								
		<b>TOP STORY</b>			<b>1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY</b>			<b>1ST STORY OF 3 STORY</b>		
<b>Exposure</b>	<b>Wind Speed</b>	<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>		
		<b>24</b>	<b>32</b>	<b>40</b>	<b>24</b>	<b>32</b>	<b>40</b>	<b>24</b>	<b>32</b>	<b>40</b>
<b>B</b>	100	0.104	0.125	0.147	0.172	0.193	0.215	0.240	0.261	0.283
	110	0.125	0.151	0.178	0.208	0.233	0.261	0.290	0.315	0.343
	120	0.149	0.180	0.212	0.247	0.278	0.310	0.345	0.375	0.408
	130	0.175	0.211	0.249	0.290	0.326	0.364	0.405	0.441	0.479
	140	0.203	0.244	0.289	0.336	0.378	0.422	0.469	0.511	0.555
	150	0.233	0.281	0.332	0.386	0.434	0.485	0.539	0.587	0.638
<b>C</b>	100	0.145	0.175	0.207	0.240	0.270	0.302	0.336	0.365	0.397
	110	0.176	0.212	0.250	0.291	0.327	0.365	0.406	0.442	0.481
	120	0.209	0.252	0.298	0.346	0.389	0.435	0.484	0.526	0.572
	130	0.245	0.296	0.349	0.406	0.457	0.510	0.567	0.618	0.672
	140	0.285	0.343	0.405	0.471	0.530	0.592	0.658	0.716	0.779
	150	0.327	0.393	0.465	0.541	0.608	0.680	0.756	0.822	0.894

**REQUIRED SHEARWALL LENGTH PERPENDICULAR TO RIDGE No. 5 REINFORCEMENT PER FOOT OF**  
**BUILDING LENGTH<sup>1,2,3,4,6</sup>**

		<b>ROOF ANGLE 45°</b>								
		<b>TOP STORY</b>			<b>1ST STORY OF 2 STORY OR 2ND STORY OF 3 STORY</b>			<b>1ST STORY OF 3 STORY</b>		
<b>Exp</b>	<b>Wind Speed</b>	<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>			<b>BUILDING WIDTH</b>		
		<b>24</b>	<b>32</b>	<b>40</b>	<b>24</b>	<b>32</b>	<b>40</b>	<b>24</b>	<b>32</b>	<b>40</b>
<b>B</b>	100	0.083	0.100	0.118	0.138	0.155	0.173	0.192	0.209	0.227
	110	0.100	0.121	0.143	0.166	0.187	0.209	0.232	0.253	0.275
	120	0.120	0.144	0.170	0.198	0.223	0.249	0.277	0.301	0.327
	130	0.140	0.169	0.200	0.232	0.261	0.292	0.325	0.353	0.384
	140	0.163	0.196	0.232	0.270	0.303	0.339	0.376	0.410	0.445
	150	0.187	0.225	0.266	0.310	0.348	0.389	0.432	0.470	0.511
<b>C</b>	100	0.116	0.140	0.166	0.193	0.217	0.242	0.269	0.293	0.319
	110	0.141	0.170	0.201	0.233	0.262	0.293	0.326	0.355	0.386
	120	0.168	0.202	0.239	0.278	0.312	0.349	0.388	0.422	0.459
	130	0.197	0.237	0.280	0.326	0.366	0.409	0.455	0.495	0.539
	140	0.228	0.275	0.325	0.378	0.425	0.475	0.528	0.575	0.625
	150	0.262	0.316	0.373	0.434	0.488	0.545	0.606	0.660	0.717

**Notes**

1. The cumulative shear wall segment length for each side of the building shall be equal to or greater than the tabular shear wall length required. If the required shear wall segment length provided is not continuous the total shear wall length required shall be increased by 8" for each additional shear wall segment on a side.
2. Minimum shear wall segment length shall be 2'-0". A minimum length of 24 inches (610 mm) of solid wall segment, extending the full height of each wall story, shall be provided at all interior and exterior corners of exterior walls A filled cell with reinforcing steel shall be provided at each end of every shear wall segment.
3. Portions of walls with openings shall not be considered part of the shear wall length.
4. Required shearwall lengths perpendicular to the ridge are per lineal foot of building length. Multiply tabular values by building length for total shear load.
5. Shearwall lengths for No. 4 reinforcement are based on shearwall segment height of 80 inches and shearwall segment length of 24 inches. Multiply tabular length by shearwall adjustment factor from Table 609.8.1-L for other segment lengths and heights.
6. Shearwall lengths for no. 5 reinforcement are based on shearwall segment height of 96 inches and shearwall segment length of 24 inches. Multiply tabular length by shearwall adjustment factor from Table 609.8.1L for other segment height lengths and heights.

**TABLE 609.8.1-L  
SHEARWALL LENGTH ADJUSTMENT FACTOR FOR GRADE 40 STEEL**

AREA OF STEEL, IN <sup>2</sup>	MAX SEGMENT HGT (in.) <sup>1</sup>	MINIMUM SEGMENT LENGTH (inches)						
		24	32	40	48	56	64	72
0.20 (No. 4)	80	1.00	0.94	0.90	0.87	0.85	0.84	0.82
	88	1.09	1.02	0.98	0.95	0.93	0.91	0.90
	96	1.19	1.11	1.07	1.03	1.01	0.99	0.98
	104	1.28	1.20	1.15	1.11	1.09	1.07	1.05
0.31 (No. 5)	80	1.00	0.93	0.89	0.87	0.85	0.83	0.82
	88	1.10	1.02	0.98	0.95	0.93	0.91	0.90
	96	1.00	0.93	0.89	0.87	0.85	0.83	0.82
	104	1.29	1.20	1.15	1.11	1.09	1.07	1.05


**TABLE R609.8.3A  
TOTAL SHEAR AT TOP OF TOP STORY WALL<sup>1,2</sup>**

EXP	WIND SPEED	VEL PRESSURE	ROOF ANGLE UP TO 45			ROOF ANGLE UP TO 30		
			BUILDING WIDTH			BUILDING WIDTH		
			24	32	40	24	32	40
B	100	15.2	2022	3113	4456	1568	2319	3215
	110	18.4	2447	3767	5392	1897	2806	3890
	120	22.0	2912	4483	6417	2258	3339	4630
	130	25.8	3418	5262	7531	2649	3919	5433
	140	29.9	3964	6102	8734	3073	4545	6301
	150	34.3	4550	7005	10027	3527	5218	7234
C	100	21.4	2835	4365	6248	2198	3251	4507
	110	25.9	3431	5282	7560	2660	3934	5454
	120	30.8	4083	6286	8997	3165	4682	6491
	130	36.1	4792	7377	10559	3715	5495	7618
	140	41.9	5557	8555	12246	4308	6372	8835
	150	48.1	6380	9821	14058	4946	7315	10142

1. Loads are based on 10' wall height. Multiply by 0.9 for 8' wall heights
2. To determine individual connector load parallel to the wall) divide shear value by the number of connectors (Load F1 from Figure 609.8.3)

**TABLE R609.8.3B  
TRANSVERSE CONNECTOR LOAD (F2)<sup>1,2</sup>**

EXP	WIND SPEED	VEL PRESSURE	ROOF ANGLE < 23°		RF ANGLE => 23°
			Edge Zone	Int Zone	
B	100	15.2	394	319	289
	110	18.4	477	386	349
	120	22.0	568	460	416
	130	25.8	667	539	488
	140	29.9	773	626	566
	150	34.3	887	718	650
C	100	21.4	553	448	405
	110	25.9	669	541	490
	120	30.8	796	644	583
	130	36.1	935	756	684
	140	41.9	1084	877	793
	150	48.1	1244	1007	911

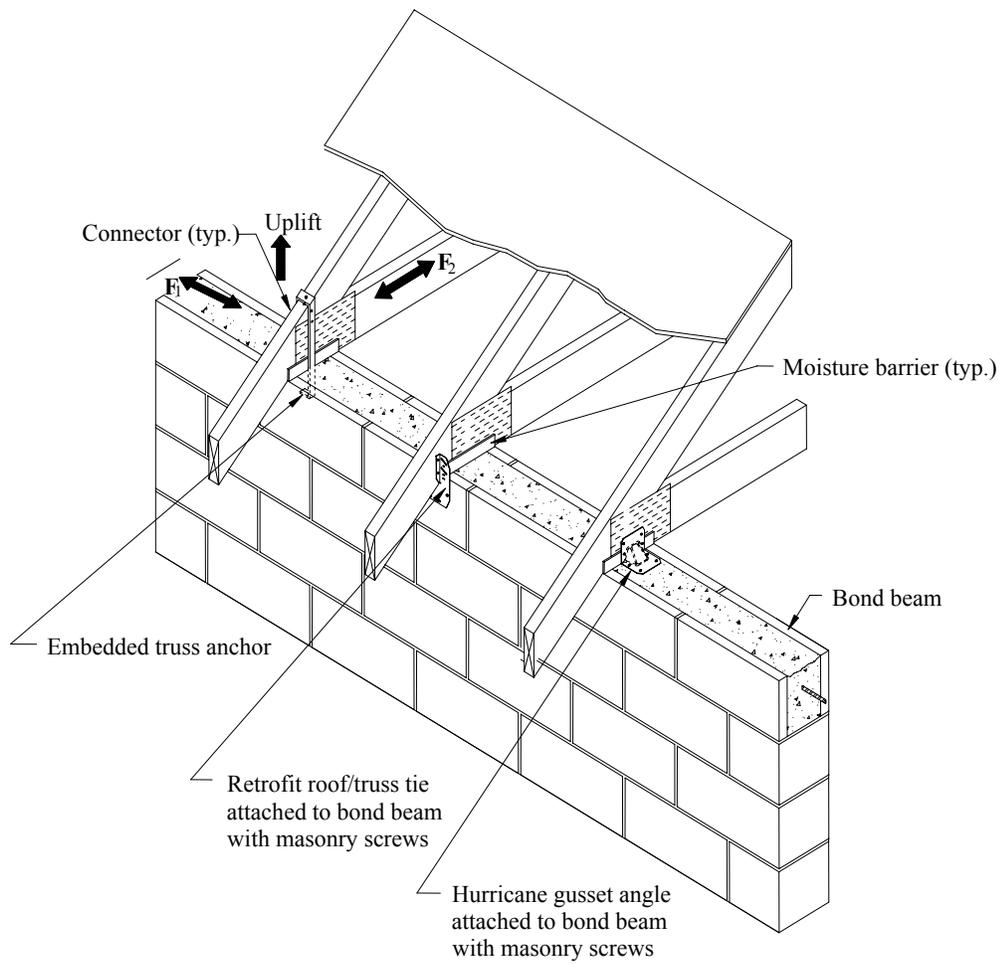

**FIGURE R609.8.3**  
**TYPICAL ROOF TO WALL CONNECTIONS**

**TABLE R609.8.4  
END WALL ROOF SHEAR PER FOOT OF BUILDING LENGTH**

EXPOSURE	WIND SPEED	POUNDS PER FT OF BLDG LENGTH FOR 23° ROOF SLOPE			POUNDS PER FT OF BLDG LENGTH FOR 30° ROOF SLOPE			POUNDS PER FT OF BLDG LENGTH FOR 45° ROOF SLOPE		
		BUILDING WIDTH			BUILDING WIDTH			BUILDING WIDTH		
		24	32	40	24	32	40	24	32	40
B	100	43.6	42.8	43.1	76.9	87.8	100.1	104.4	123.8	145.1
	110	52.7	51.8	52.2	93.1	106.3	121.1	126.3	149.8	175.5
	120	62.8	61.7	62.1	110.8	126.5	144.2	150.3	178.3	208.9
	130	73.7	72.4	72.8	130.0	148.5	169.2	176.4	209.2	245.1
	140	85.4	84.0	84.5	150.8	172.2	196.2	204.6	242.6	284.3
	150	98.1	96.4	97.0	173.1	197.7	225.3	234.8	278.5	326.4
C	100	61.1	60.1	60.4	107.9	123.2	140.4	146.3	173.6	203.4
	110	73.9	72.7	73.1	130.5	149.0	169.9	177.1	210.0	246.1
	120	88.0	86.5	87.0	155.3	177.4	202.1	210.7	249.9	292.9
	130	103.3	101.5	102.1	182.3	208.1	237.2	247.3	293.3	343.7
	140	119.8	117.7	118.4	211.4	241.4	275.1	286.8	340.2	398.6
	150	137.5	135.2	136.0	242.7	277.1	315.8	329.2	390.5	457.6

**Notes:**

1. Tabular values between 23° and 30° and between 30° and 45° are permitted to be interpolated.
2. Multiply by total building length for total end wall shear. Divide total shear by building width for required shear capacity of roof diaphragm and connections

**R609.9 Assemblies and beams spanning openings.**

**R609.9.1 Pre-engineered Assemblies for Masonry Walls.**

**R609.9.1.1** Unreinforced masonry units above an opening and 8 inch high bond beams above an opening shall be supported by an assembly.

**R609.9.1.2** Pre-engineered assemblies shall be selected from a manufacturer's approved schedule or other approved tables for the load capacities based on the appropriate minimum gravity load carrying capacities established in Tables 609.9.1.2(1), 609.9.1.2(2), and 609.9.1.2(3).

**R609.9.1.3** Pre-engineered assemblies may function as a bond beam over an opening provided that:

1. The bond beam reinforcement is continuous through the assembly.
2. The assembly has an uplift rating that equals or exceeds the appropriate value stipulated in Table 609.9.1(1) if the lintel directly supports a roof.

**Exception:** If the reinforcement in the top of the assembly is equal to or greater than the reinforcement required in the bottom of the assembly by the manufacturer, uplift need not be considered.

**R609.9.1.4** Pre-engineered assemblies spanning openings shall extend a minimum of 4 inches nominal past each side of the opening.

**TABLE R609.9.1.2(1)**  
**SUPERIMPOSED LOADS**  
**MINIMUM RATED LOAD CAPACITY OF 6 INCH OR 8 INCH THICK**  
**PRE-ENGINEERED ASSEMBLIES SPANNING OPENINGS OF**  
**ONE STORY AND TOP STORY OF MULTI-STORY BUILDINGS**


ROOF SPAN (FT)	UPLIFT (PLF)			
	GRAVITY (PLF)	100 MPH	120 MPH	140 mph
42	150	85	112	165
12	330	152	204	305
24	600	262	351	525
36	870	374	502	745
44	1,050	451	605	900
52	1,230	530	710	1,050
60	1,410	609	816	1,210

Notes:

1. All loads are superimposed at the top of the wall and do not include dead loads of the bond beam or masonry above the assembly. Add 100% of additional dead loads to the gravity loads and subtract 85% of these loads from the uplift loads.
2. Use 4-foot roof span for assemblies in endwalls.  
 For total roof dead loads over 10 psf, increase gravity loads by the following amount:

$$\frac{(\text{Roof Dead Load} - 10 \text{ psf}) \times (\text{Roof Span} + 2 \text{ ft})}{2}$$


3. Uplift rating is required only if a pre-engineered assembly is used to directly support a roof. (See Section R609.9.1.3(2) for cases where uplift need not be considered.)

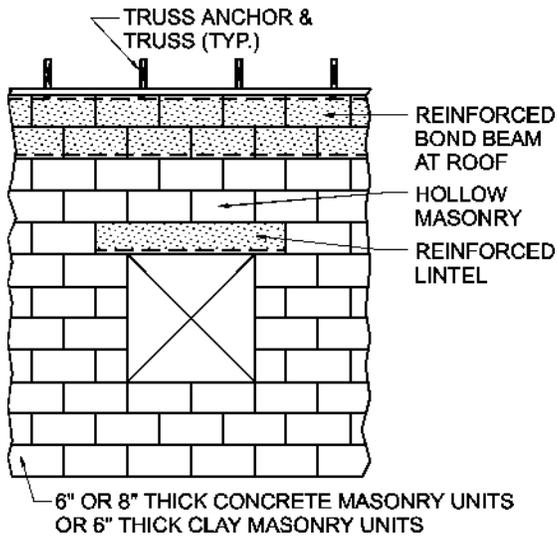

**Pacific A 1**

**TABLE R609.9.1.2(2)**  
**SUPERIMPOSED LOADS**  
**MINIMUM RATED LOAD CAPACITY OF 8 INCH THICK**  
**PRE-ENGINEERED ASSEMBLIES SPANNING OPENINGS OF**  
**BOTTOM STORY OF TWO-STORY BUILDINGS, SECOND AND BOTTOM STORIES OF**  
**THREE-STORY BUILDINGS—WOOD FLOOR SYSTEM**

Floor <sup>1</sup> Span (ft)	Minimum Rated Gravity Load Assembly (plf)					
	Assembly Clear Span (ft)					
	4	6	8	12	16	20
42	210	260	310	410	510	610
12	430	480	530	630	730	830
24	760	810	860	960	1,060	1,160
36	1,090	1,140	1,190	1,290	1,390	1,490
44	1,310	1,360	1,410	1,510	1,610	1,710
52	1,530	1,580	1,630	1,730	1,830	1,930
60	1,750	1,800	1,850	1,950	2,050	2,150

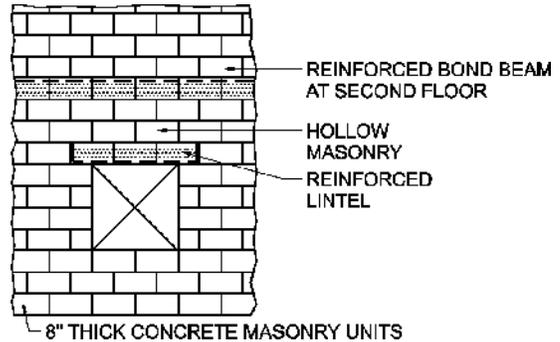


**Notes:**

- For a wall supporting floors on both sides, enter Table with the sum of the 2 full spans.  
Note: Tabular values are for 1/2 the load of the full span shown.
- Use 4 ft building width for assemblies in nonfloorbearing walls (normally endwalls and interior masonry walls and shearwalls).
- The values in this table may be interpolated.
- These loads take into account the dead load of any masonry in the wall above the assembly and live and dead loads of the roof and floor supported. Dead load of the assembly is not included in the table and if not included in the pre-engineered concrete design must be added to the loads in the table.
- This table is applicable for all roof dead loads.

**TABLE R609.9.1.2(3)**  
**SUPERIMPOSED LOADS**  
**MINIMUM RATED LOAD CAPACITY OF NOMINAL 8 INCH THICK**  
**PRE-ENGINEERED ASSEMBLIES SPANNING OPENINGS OF**  
**BOTTOM STORY OF TWO-STORY BUILDINGS, SECOND AND BOTTOM STORIES OF**  
**THREE-STORY BUILDINGS—HOLLOWCORE FLOOR SYSTEM**

Floor <sup>1</sup> Span (ft)	Minimum Rated Gravity Load of Assembly (plf)					
	Assembly Clear Span (ft)					
	4	6	8	12	16	20
42	290	340	390	490	590	690
12	670	720	770	870	970	1,070
24	1,240	1,290	1,340	1,440	1,540	1,640
36	1,810	1,860	1,910	2,010	2,110	2,210
44	2,190	2,240	2,290	2,390	2,490	2,590
52	2,570	2,620	2,670	2,770	2,870	2,970
60	2,950	3,000	3,050	3,150	3,250	3,350

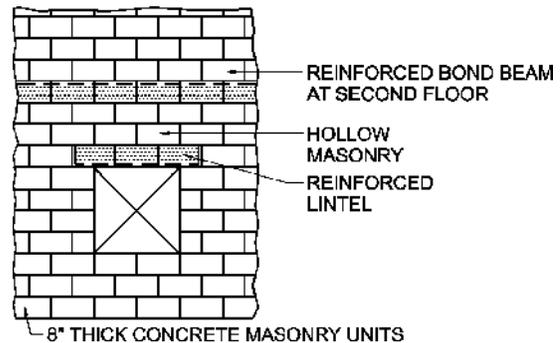

**Notes:**

- For a wall supporting floors on both sides, enter Table with the sum of the 2 full spans.  
Note: Tabular values are for 1/2 the load of the full span shown.
- Use 4 ft building width for assemblies in nonfloorbearing walls (normally endwalls and interior masonry walls and shearwalls).
- The values in this table may be interpolated.
- These loads take into account the dead load of any masonry in the wall above the assembly and live and dead loads of the roof and floor supported. Dead load of the assembly is not included in the table and if not included in the pre-engineered concrete assembly design must be added to the loads in the table.
- This table is applicable for all roof dead loads.

**609.9.2 Continuous bond beams spanning openings.**

**609.9.2.1 Under the provisions of this section, bond beams shall:**

- Be 16 inches high nominal over openings, except cast-in-place concrete bond beams which may be 12 inches high nominal.

2. Have top reinforcement continuous over the wall and opening.
3. Have bottom reinforcement extending past each side of the opening a minimum of 24 inches for concrete walls and 4 inches for masonry walls.
4. Meet the provisions of Tables R609.9.2.1(1), R609.9.2.1 (2), and R609.9.2.1 (3) as appropriate.

**609.9.2.2** Top reinforcement required over the opening which is in addition to that required over the wall shall extend past the opening a minimum of 24 inches.

**609.9.2.3** When pre-engineered assemblies are utilized to form the bottom portion of the bond beam over the opening in masonry walls, the bottom reinforcement of the pre-engineered assemblies shall be counted toward the additional bottom reinforcement required over the opening.

**R609.9.3 Bond beams combined with lintels.**


**609.9.3.1** The provisions of this section shall apply when the lintel, the wall area between the lintel and the bond beam, and the bond beam itself are solid grouted masonry units or cast together as one unit.

**TABLE R609.9.2.1(1)**  
**MAXIMUM CLEAR SPAN CAPACITY OF CONTINUOUS BOND BEAMS ACTING AS LINTELS**  
**ONE STORY AND TOP STORY OF MULTI-STORY BUILDINGS**

Roof Span (ft)	Maximum Allowable Clear Span (ft-in) <sup>5</sup>											
	Bond Beam 6" Thick Wall <sup>1,2,4</sup>						Bond Beam 8" Thick Wall <sup>1,2,4</sup>					
	16-1	16-2	C12-1	C12-2	C16-1	C16-2	16-1	16-2	C12-1	C12-2	C16-1	C16-2
4 <sub>3</sub>	16-0	17-4	16-0	20-8	18-0	24-8	16-0	18-8	15-4	20-8	17-4	23-4
12	12-0	13-4	12-0	15-4	14-0	18-8	12-8	14-0	11-4	16-0	13-4	18-0
24	8-8	8-8	9-4	10-8	10-8	14-8	10-0	11-4	8-8	12-8	10-8	14-8
36	6-8	6-8	8-0	8-0	9-4	11-4	8-8	8-8	7-4	10-0	8-8	12-0
44	6-0	6-0	7-4	7-4	8-0	10-0	7-4	7-4	6-8	8-8	8-0	11-4
52	5-4	5-4	6-0	6-0	8-0	8-8	6-8	6-8	6-8	8-0	7-4	10-8
60	4-8	4-8	6-0	6-0	7-4	8-0	6-0	6-0	6-0	7-4	7-4	10-0

Notes:

1. Designation of bond beam types over openings:
  - a. Letter C designates a concrete bond beam. All other bond beams are masonry.
  - b. The first number denotes the nominal height of the bond beam in inches.
  - c. The second number denotes the number of #5 reinforcing bars in the top and the bottom of the beam. 1 -#7 may be used in lieu of 2-#5. The bottom reinforcing steel shall be located no more than 2 3/4 inches clear distance from the bottom of masonry bond beams and 1 1/2 inches for concrete bond beams.
2. All bond beams have reinforcement in the top as required by Tables R609.8.2A and Tables R609.8.2B-1 through R609.8.2B-4 as appropriate. If 2-#5 are required in this table and only 1 -#5 by Table R609.8.2A plus Tables R609.8.2B-1 through R609.8.2B-4 as appropriate, the additional bar shall be placed in the top of the bond beam over the opening and shall extend past the opening a minimum of 24 inches.
3. Use 4 foot roof span for lintels in endwalls.
4. The bottom reinforcement in precast lintels may be used to satisfy the continuous bond beam bottom reinforcement requirement.
5. For roof dead loads more than 10 psf:
  - a. For 20 psf roof dead load, multiply allowable clear spans by 0.85.
  - b. For 30 psf roof dead load, multiply allowable clear spans by 0.75.
  - c. Values for other roof dead loads may be interpolated.

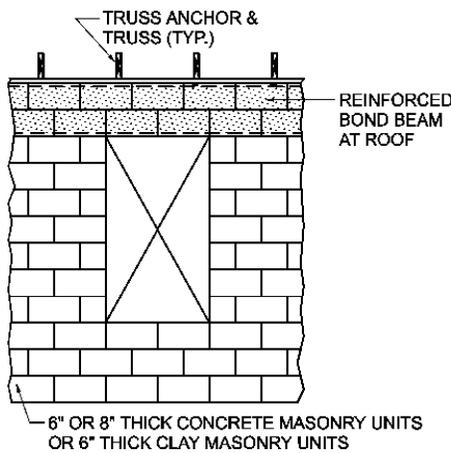

**Pacific A 2**

**TABLE R609.9.2.1(2)**  
**MAXIMUM CLEAR SPAN CAPACITY OF CONTINUOUS BOND BEAMS ACTING AS LINTELS**  
**BOTTOM STORY OF TWO-STORY BUILDINGS, SECOND AND BOTTOM STORIES OF**  
**THREE-STORY BUILDINGS—WOOD FLOOR SYSTEM**


BUILDING WIDTH (FT)	MAXIMUM ALLOWABLE CLEAR SPAN (FT-IN) <sup>5</sup>						
	BOND BEAM 8" THICK WALL <sup>1,2,4</sup>						
	16-1	16-2	C12-1	C12-2	C16-1	C16-2	C16-3
43	11-4	13-4	10-8	14-0	12-0	15-4	18-0
12	10-0	11-4	9-4	12-0	10-8	14-0	16-0
24	8-8	8-8	8-0	10-0	8-8	12-0	12-8
36	6-8	6-8	6-8	8-0	8-0	10-8	10-8
44	6-0	6-0	6-0	7-4	7-4	9-4	9-4
52	5-4	5-4	6-0	6-8	6-8	8-8	8-8
60	4-8	4-8	5-4	6-0	6-8	8-0	8-0

**TABLE R609.9.2.1(3)**  
**MAXIMUM CLEAR SPAN CAPACITY OF**  
**CONTINUOUS BOND BEAMS ACTING AS LINTELS**  
**BOTTOM STORY OF TWO-STORY BUILDINGS, SECOND AND BOTTOM STORIES OF**  
**THREE-STORY BUILDINGS—HOLLOWCORE SECOND FLOOR**

BUILDING WIDTH (FT)	MAXIMUM ALLOWABLE CLEAR SPAN (FT-IN) <sup>5</sup>						
	BOND BEAM 8" THICK WALL <sup>1,2,4</sup>						
	16-1	16-2	C12-1	C12-2	C16-1	C16-2	C16-3
43	10-8	12-0	10-0	13-4	11-4	14-8	17-4
12	8-8	9-4	8-0	10-8	9-4	12-0	13-4
24	6-0	6-0	6-0	7-4	7-4	10-0	10-0
36	4-8	4-8	5-4	6-0	6-0	8-0	8-0
44	4-0	4-0	4-8	5-4	6-0	7-4	7-4
52	4-0	4-0	4-8	4-8	5-4	6-8	6-8
60	3-4	3-4	4-0	4-0	5-4	6-0	6-0

Notes for Tables r609.9.2.1(2) and r609.9.2.1(3):

1. Designation of bond beam over openings:
  - a. Letter C designates a concrete bond beam. All the bond beams are masonry.
  - b. The first number denotes the nominal height of the bond beam in inches.
  - c. The second number denotes the number of #5 reinforcing bars in the top and the bottom of the beam. 1 -#7 may be used in lieu of 2-#5. The bottom reinforcing steel shall be located no more than 2 3/4 inches clear distance from the bottom of masonry bond beams and 1 1/2 inches for concrete bond beams.
2. All bond beams shall have reinforcement in the top in accordance with Section R609.9.2.
3. Use 4 foot floor span for lintels in walls parallel to hollowcore.
4. The bottom reinforcement in precast lintels may be used to satisfy the continuous bond beam bottom reinforcement requirement.
5. This table is applicable for all roof dead loads.

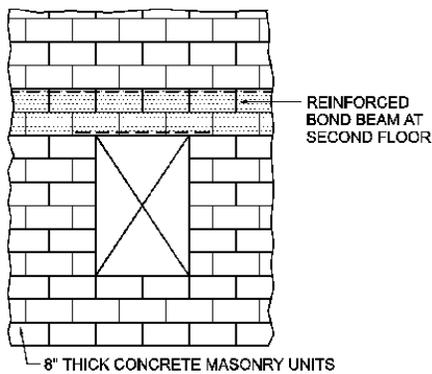

**Pacific A 3**

**R609.9.3.2** Combined bond beams/lintels shall meet the requirements of the appropriate Table 609.9.3.2(1), (2), or (3).

**Exception:** Bottom reinforcement over openings in concrete walls shall be a minimum of two No. 5 bars or one No. 7 bar.

**R609.9.3.3** Top reinforcement which is in addition to that required in the bond beam over the wall shall extend a minimum of 24 inches past each side of the opening. Top bond beam reinforcement shall be continuous over wall and opening.

**609.9.3.4** Bottom reinforcing shall extend past each side of the opening a minimum of 24 inches for concrete walls and 4 inches for masonry walls. When using a precast lintel, the reinforcing in the precast lintel shall be included when determining the total amount of bottom reinforcement furnished.


**609.9.3.5** For masonry walls, a cleanout (12 sq. in. min.) shall be provided in the cells directly above the ends of the lintel when the reinforcing steel in the bottom of the lintel is more than 22 inches below the top of the bond beam.

**TABLE R609.9.3.2(1)  
COMBINED BOND BEAM/LINTELS  
ONE STORY AND TOP STORY OF MULTI-STORY BUILDINGS**

Bond Beam Thickness (ft)	Roof Span (ft)	Maximum Allowable Clear Span (ft.-in.)															
		Combined Bond Beam/Lintel 6" or 8" Thick Wall <sup>1, 2</sup>															
		12-1	12-2	16-1	16-2	24-1	24-2	24-3	32-2	32-3	32-4	40-2	40-3	40-4	48-3	48-4	48-5
6"	4	11-4	12-0	14-8	16-0	18-8	22-8	23-4	27-4	29-4	30-0	29-4	34-0	35-4	38-0	39-4	40-8
	12	8-0	8-8	11-4	12-0	14-8	17-4	18-8	22-9	23-3	24-8	24-8	28-9	29-4	31-4	33-4	34-0
	24	6-0	6-9	8-8	8-8	11-4	14-0	14-0	18-0	18-0	18-0	20-0	22-0	22-0	26-0	26-0	26-0
	36	4-8	4-8	6-8	6-8	10-0	10-8	10-8	14-0	14-0	14-0	17-4	17-4	17-4	20-8	20-8	20-8
	44	4-0	4-0	6-0	6-0	9-4	9-4	9-4	12-8	12-8	12-8	15-4	15-4	15-4	18-0	18-0	18-0
	52	3-4	3-4	5-4	5-4	8-0	8-0	8-0	11-4	11-4	11-4	14-0	14-0	14-0	16-8	16-8	16-8
60	3-4	3-4	4-8	4-8	7-4	7-4	7-4	10-0	10-0	10-0	12-8	12-8	12-8	15-4	15-4	15-4	
8"	4	12-0	12-8	14-8	16-8	17-4	23-4	24-8	25-4	30-0	30-8	26-8	32-8	35-4	34-0	39-4	40-8
	12	8-8	9-4	11-4	13-4	14-0	18-8	20-0	21-4	24-8	26-0	22-8	28-0	30-0	29-4	34-0	35-4
	24	6-8	7-4	9-4	10-0	11-4	15-4	16-0	17-4	20-8	21-4	19-4	23-4	25-4	25-4	28-8	30-0
	36	6-0	6-0	8-0	8-8	9-4	13-4	13-4	15-4	17-4	17-4	16-8	20-8	21-4	22-0	24-8	24-8
	44	5-4	5-4	7-4	7-4	8-8	11-4	11-4	14-0	15-4	15-4	16-0	18-8	18-8	20-8	22-0	22-0
	52	4-8	4-8	6-8	6-8	8-0	10-0	10-0	13-4	14-0	14-0	14-8	17-4	17-4	19-4	20-0	20-0
60	4-0	4-0	6-0	6-0	8-0	9-4	9-4	12-8	12-8	12-8	14-0	15-4	15-4	18-8	18-8	18-8	

**Notes:**

1. Designation of combined bond beam/lintels:
  - a. The first number denotes the nominal height of the bond beam/lintel in inches.
  - b. The second number denotes the number of #5 reinforcing bars in the bottom of the bond beam/lintel. The equivalent or greater area of reinforcement may be obtained by using reinforcement other than #5. For example, when 3-#5 are required 1-#9 may be used. Also, 1-#7 may be used to replace 2-#5 or 2-#7 to replace 4-#5. The bottom reinforcing steel is to be located not more than 2 3/4 inches clear distance from the bottom of the lintel.
2. All bond beams shall have reinforcement in the top in accordance with R609.8.2A and Tables R609.8.2B-1 through R609.8.2B-4, as appropriate.

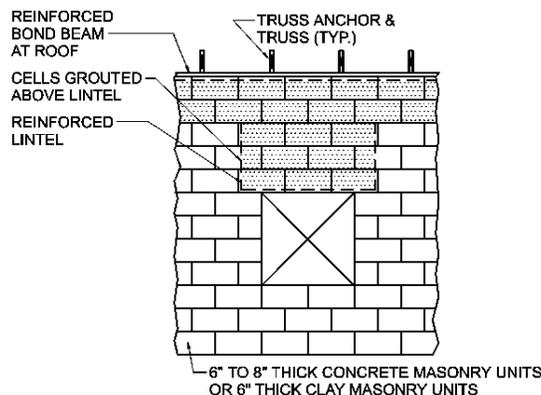

**TABLE R609.9.2.2(2)**  
**COMBINED BOND BEAM/LINTELS**  
**BOTTOM STORY OF TWO-STORY BUILDINGS, SECOND AND BOTTOM STORIES**  
**OF THREE STORY BUILDINGS - WOOD FLOOR SYSTEM**


Floor Span Supported (ft)	Maximum Allowable Clear Span (ft-in) <sup>5</sup> Combined Bond Beam Lintel 8" Thick Wall <sup>1,2,4</sup>									
	12-2	16-2	24-2	24-3	32-2	32-3	40-3	40-4	48-3	48-4
4 <sub>3</sub>	9-4	12-0	16-0	16-8	18-0	20-0	22-8	24-0	24-0	26-8
12	8-0	10-8	14-0	15-4	16-0	18-8	20-8	22-0	22-0	24-0
24	6-0	8-8	12-0	12-0	14-0	15-4	18-0	18-0	20-0	20-8
36	4-8	6-8	10-0	10-0	12-8	13-4	16-0	16-0	18-0	18-0
44	4-0	6-0	9-4	9-4	12-0	12-0	14-8	14-8	16-8	16-8
52	4-0	5-4	8-8	8-8	10-8	10-8	13-4	13-4	16-0	16-0
60	3-4	4-8	8-0	8-0	10-0	10-0	12-8	12-8	14-8	14-8

**TABLE R609.9.3.2(3)**  
**COMBINED BOND BEAM/LINTELS**  
**BOTTOM STORY OF TWO-STORY BUILDINGS, SECOND AND BOTTOM STORIES OF THREE-STORY**  
**BUILDINGS - HOLLOWCORE FLOOR SYSTEM**

Floor Span Supported (ft)	Maximum Allowable Clear Span (ft-in) <sup>5</sup> Combined Bond Beam/Lintel 8" Thick Wall <sup>1,2,4</sup>									
	12-2	16-2	24-2	24-3	32-2	32-3	40-3	40-4	48-3	48-4
4 <sub>3</sub>	8-8	11-4	15-4	16-0	17-4	19-4	22-0	23-4	23-4	25-4
12	6-8	9-4	12-8	12-8	14-8	16-0	18-8	18-8	20-8	21-4
24	4-8	6-0	9-4	9-4	12-0	12-0	14-8	14-8	17-4	17-4
36	3-4	4-8	7-4	7-4	10-0	10-0	12-0	12-0	14-8	14-8
44	2-8	4-0	6-8	6-8	8-8	8-8	11-4	11-4	13-4	13-4
52	2-8	4-0	6-0	6-0	8-0	8-0	10-0	10-0	12-0	12-0
60	2-8	3-4	5-4	5-4	7-4	7-4	9-4	9-4	11-4	11-4

Notes for T. R609.9.3.2(2) and R609.9.3.2(3):

- Designation of combined bond beam/lintels:
  - The first number denotes the nominal height of the bond beam/lintel in inches.
  - The second number denotes the number of #5 reinforcing bars in the bottom of the bond beam/lintel. The equivalent or greater area of reinforcement may be obtained by using reinforcement other than #5 bars. For example, when 3-#5 are required, 1-#9 may be used. Also, 1-#7 may be used to replace 2-#5 or 2-#7 may be used to replace 4-#5. The bottom reinforcing steel is to be located not more than 2 3/4 inches clear distance from the bottom of the lintel.
- All bond beams shall have reinforcement in the top in accordance with Section 609.9.2.
- Use 4 foot floor span for walls parallel to hollowcore (nonloadbearing).
- All The bottom reinforcement in precast lintels may be used to satisfy the continuous bond beam bottom reinforcement requirement.
- This table is applicable for all roof dead loads.

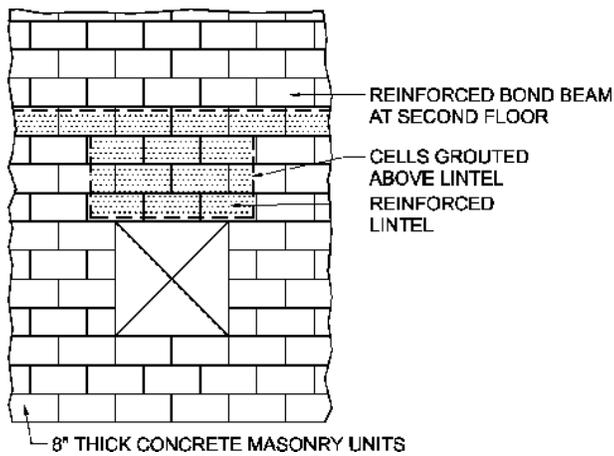

**Reason:** The proposal is superior to the current code provisions in that the structural provisions of the Code are not useable in large portions of the country and the world, The proposal provides prescriptive provisions for areas with basic wind speeds of 100 mph or greater. The purpose of the proposed code change is to provide prescriptive provisions for the construction of wind resistant concrete masonry dwellings. The experience of the last three hurricane seasons underscores the need for guidance in the construction of wind resistant dwellings. All predictions are for continued active hurricane seasons. The proposed tables were all generated using the strength design provisions of ACI 530-05.

**Cost Impact:** The code change proposal will not increase the cost of construction where residences were properly designed and constructed for wind resistance. In addition, the current code provisions do not address wind resistance so the code cannot be used to build such structures.

Public Hearing: Committee: AS AM D  
 Assembly: ASF AMF DF

## **RB164-06/07**

### **R602**

**Proponent:** Robert Boyer, Palm Beach County, Longwood, FL, representing The Building Officials Association of Florida

**Delete current Section R602 and substitute as follows:**

#### **SECTION R602** **WOOD WALL FRAMING**

**R602.1 General Requirements.** Exterior walls of light-frame wood construction shall be in accordance with the provisions of this chapter.

**R602.1.1 Identification.** Load-bearing dimension lumber for studs, plates and headers shall be identified by a grade mark of a lumber grading or inspection agency that has been approved by an accreditation body that complies with DOC PS 20. In lieu of a grade mark, a certification of inspection issued by a lumber grading or inspection agency meeting the requirements of this section shall be accepted.

**R602.1.1.1 End-jointed lumber.** Approved end-jointed lumber identified by a grade mark conforming to Section R602.1 may be used interchangeably with solid-sawn members of the same species and grade.

**R602.1.1.2 Structural glued laminated timbers.** Glued laminated timbers shall be manufactured and identified as required in AITC A190.1 and ASTM D3737.

**R602.1.1.3 Structural log members.** Stress grading of structural log members of nonrectangular shape, as typically used in log buildings, shall be in accordance with ASTM D 3957. Such structural log members shall be identified by the grade mark of an approved lumber grading or inspection agency. In lieu of a grade mark on the material, a certificate of inspection as to species and grade issued by a lumber-grading or inspection agency meeting the requirements of this section shall be permitted to be accepted.

**R602.1.2 Fireblocking Required.** Fireblocking shall be provided to cut off all concealed draft openings (both vertical and horizontal) and to form an effective fire barrier between stories, and between a top story and the roof space. Fireblocking shall be provided in wood-frame construction in the following locations: