

A117.1 draft for Supplement 1 for the 2017 ICC A117.1

6-90-2021 AM – this whole section is new text. Revisions from the public comments received are shown in legislative text. At this time, comments are limited to revisions.

**SECTION 613
ADULT CHANGING STATIONS**

6-90-2021 AM

613.1 General. Adult changing stations shall comply with Section 613.2 through 613.4.

6-90-2021 AM

613.2 Installation location. Where provided, adult changing stations shall be installed in accordance with the locations specified in Section 613.2.1, 613.2.2 or 613.2.3.

6-90-2021 AM

613.2.1. Single user or family or assisted use toilet or bathing room. Where adult changing stations are provided in a toilet room with only one water closet and one lavatory, or in a family or assisted-use toilet or bathing room, the room shall provide all of the following components:

1. A dispenser for soap complying with Section 308.
2. A hand towel dispenser or hand dryer complying with Table 603.6.
3. A coat hook located in close proximity to the changing surface.
4. A waste receptacle.
5. Signage indicating “Adult Changing Station” provided at the entrance to the room and complying with the visual character requirements in Section 703.2.
6. Signage indicating the weight capacity and instructions for operation of the changing station within the room.

6-90-2021 AM

613.2.2 Multi-user toilet or bathing room. Where adult changing stations are provided in a multi-user toilet or bathing room, the adult changing station shall be located in a compartment that includes all of the following components:

1. Privacy provided by walls, curtains or partitions enclosing the compartment.
2. A turning space complying with Section 304.
3. A lavatory complying with Section 606.
4. A dispenser for soap complying with Section 308.
5. A hand towel dispenser or hand dryer complying with Table 603.6.
6. A coat hook in close proximity to the changing surface.
7. A waste receptacle.
8. Signage indicating “Adult Changing Station” provided at the entrance to the room and complying with the visual character requirements in Section 703.2.
9. Signage indicating the weight capacity and instructions for operation of the changing station within the compartment.

6-90-2021 AM

613.2.3 Room or space other than a toilet room or bathing room. Where adult changing stations are provided in a room or space other than a toilet or bathing room and including, but

not limited to, nurses' work areas, therapist work areas, or special education classrooms, the adult changing station shall be located in a compartment or room that includes all of the following components:

1. Privacy provided by walls, curtains or partitions.
2. A turning space complying with Section 304.
3. A lavatory complying with Section 606 or an alcohol-based hand sanitizer dispenser.
4. Where a lavatory is provided in the compartment or room, provide a dispenser for soap.
5. Where a lavatory is provided in the compartment or room, provide a hand towel dispenser or hand dryer complying with Table 603.6.
6. A waste receptacle.
7. Signage indicating the weight capacity and instructions for operation of the changing station within the room.

6-90-2021 AM/AFMPC3

613.3 Room clearance configurations. An adult changing station and its supporting structure shall not obstruct required clear floor spaces and maneuvering clearances at accessible elements, fixtures, maneuvering clearances at the adult changing stations, maneuvering clearances at doors, or the wheelchair turning spaces.

6-90-2021 AM

613.4 Changing surface. A changing surface shall be provided and shall comply with Section 613.4.

6-90-2021 AM

613.4.1 Size. The changing surface shall be 70 inches (1778mm) minimum in length and 30 inches (762mm) minimum in width.

6-90-2021 AM/AFMPC2

613.4.2 Capacity. Materials, fastening mounting devices, and support structure shall support a user weight of 400 lbs. (182 kg) minimum.

6-90-2021 AM

613.4.3 Height adjustability. The changing surface height shall be adjustable at variable heights from 17 inches (432mm) minimum to 38 inches (965mm) maximum above the floor as measured to the top of the changing surface.

Exception: Where the adult changing station is not required by the administrative authority, a fixed height changing surface shall be permitted and shall be mounted with the top of the changing surface 19 inches (483mm) minimum and 23 inches (584 mm) maximum above the floor.

6-90-2021 AM/AFMPC3

613.4.4 Maneuvering Clearances. Maneuvering Clearances at the adult changing surface and complying with Sections 613.4.4.1 and 613.4.4.2 shall be provided. adjacent to the changing surface, and Such maneuvering clearances shall be measured ~~when~~ where the adult changing surface are is in the operational position.

6-90-2021 AM/AFMPC3

613.4.4.1 Side maneuvering clearance. A 36-inch (914mm) deep minimum side maneuvering clearance at the adult changing surface shall be provided along the open long side of the changing surface.


Exception: In the raised position, the side rail shall be permitted to overlap the side clearance.

6-90-2021 AM/AFMPC3

613.4.4.2 End maneuvering clearance. A 36-inch (914mm) wide minimum end maneuvering clearance at the adult changing surface shall be provided along the depth of one end of the changing surface. The width of the end maneuvering clearance shall extend the depth of the changing surface and the side maneuvering clearance.

Exceptions:

1. A 24-inch (610 mm) wide minimum end maneuvering clearance shall be permitted where a clear floor space complying with Section 305.3 is provided within the room beyond the maneuvering clearances for the changing surface.
2. Where installed in locations specified in Section 613.2.3, end maneuvering clearances complying with Section 613.4.4.2 is not required.

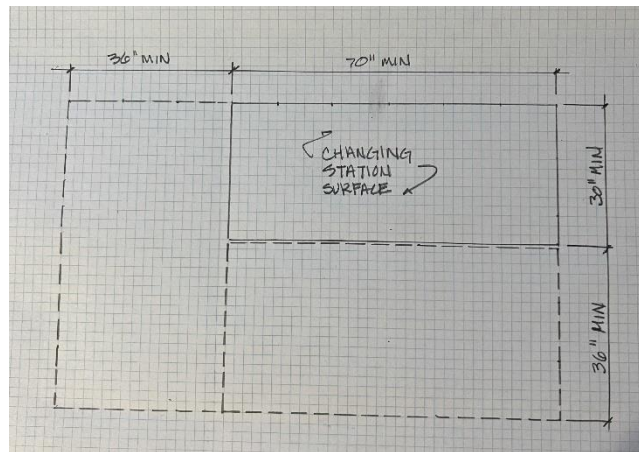

6-90-2021 AM

Figure 613.4

Size and maneuvering clearances at the adult Changing surface ~~and clearances~~